



GTEC UPS MODEL:

DISCOVERY

10 - 20 kVA

INSTALLATION MANUAL

SUMMARY

GLOSSARY OF ACRONYMS	3
PREPARATIONS	5
INSTALLATION ENVIRONMENT	5
ELECTROMAGNETIC COMPATIBILITY	6
OVERVOLTAGE PROTECTION	6
PRELIMINARY INFORMATION FOR INSTALLATION	6
INTERNAL BATTERIES	7
BATTERY MAINTENANCE	7
THREE PHASE VERSION - S3T	8
EXTERNAL PROTECTIVE DEVICES	8
RCD BREAKER (RESIDUAL CURRENT DEVICE)	8
BACKFEED PROTECTION	8
THERMAL-MAGNETIC CIRCUIT BREAKERS	9
SHORT CIRCUIT PROTECTION	9
SHORT CIRCUIT WITHSTANDING	9
INTERNAL PROTECTIVE DEVICES	9
POWER CONNECTION INFORMATION	10
ELECTRICAL CONNECTIONS (S3T)	11
WIRING DIAGRAMS FOR CONNECTING TO THE ELECTRICAL SYSTEM	11
SINGLE PHASE VERSION - S3M	12
EXTERNAL PROTECTIVE DEVICES	12
RCD BREAKER (RESIDUAL CURRENT DEVICE)	12
BACKFEED PROTECTION	12
THERMAL-MAGNETIC CIRCUIT BREAKERS	12
SHORT CIRCUIT PROTECTION	13
SHORT CIRCUIT WITHSTANDING	13
INTERNAL PROTECTIVE DEVICES	13
POWER CONNECTION INFORMATION	14
ELECTRICAL CONNECTIONS (S3M)	15
WIRING DIAGRAMS FOR CONNECTING TO THE ELECTRICAL SYSTEM	15
UPS MODELS	16
CPT	17
POSITIONING INFORMATION	17
POWER CONNECTION INSTALLATION	18
UPS DETAILS	21
POWER CONNECTION DETAILS	22
S3T - THREE PHASE VERSION	22
S3M - SINGLE PHASE VERSION	22

ACT	23
POSITIONING INFORMATION	23
POWER CONNECTION INSTALLATION	24
UPS DETAILS	27
POWER CONNECTION DETAILS	28
S3T - THREE PHASE VERSION	28
DUAL INPUT VERSION (OPTIONAL)	28
S3M - SINGLE PHASE VERSION	29
DUAL INPUT VERSION	29
XTD	30
POSITIONING INFORMATION	30
POWER CONNECTION INSTALLATION	31
UPS DETAILS	34
POWER CONNECTION DETAILS	35
S3T - THREE PHASE VERSION	35
S3M - SINGLE PHASE VERSION	35
CONNECTION OF S3M DUAL INPUT	36
COMMUNICATION INTERFACE	37
R.E.P.O.	37
PROGRAMMABLE IN – OUT SIGNALS	37
USB/SERIAL RS232	38
COMMUNICATION SLOTS	38
APPENDIX	39
JUMPERS INSTALLATION/REMOVAL	39
CHECKING THE PACKAGING CONTENTS	40
FIXING THE SIGNAL CABLE	41
REMOVING DOOR	42
ANCHORING THE UPS TO THE FLOOR	43

GLOSSARY OF ACRONYMS

Acronym	ITEM	Description
CPT	CPT Model	<i>UPS model type</i>
ACT	ACT Model	<i>UPS model type</i>
XTD	XTD Model	<i>UPS model type</i>
S3T	Three Phase Version	<i>Three phase output voltage UPS</i>
S3M	Single Phase Version	<i>Single phase output voltage UPS</i>
ER	Extended Runtime	<i>Version with high battery charging current capability</i>
DI	Dual Input	<i>Version with separated lines for Mains and Bypass input connections</i>
SLOT	Expansion Slots	<i>Slot to accomodate the communication cards and relay expansion board</i>
COM	Communication Board	<i>It includes USB + RS232 communication ports + EPO signal interface + contact interface</i>
PAR	Parallel Board	<i>Communication interface card between UPS for parallel function</i>
SWBATT	Battery Switch	<i>Internal Battery fuse holders. Warning: these fuse holders disconnect only the batteries contained in the UPS cabinet</i>
SWMB	Manual Bypass Switch	<i>Maintenance bypass switch disconnecter</i>
SWIN	Mains Input Switch	<i>Mains input switch disconnecter</i>
SWBYP	Bypass Input Switch	<i>Bypass line input switch disconnecter</i>
SWOUT	Output Switch	<i>Output switch disconnecter</i>
B+	-	<i>Positive battery voltage/current/temp.</i>
B-	-	<i>Negative battery voltage/current/temp.</i>

PREPARATIONS

READ THE "SAFETY MANUAL" BEFORE STARTING THE UPS INSTALLATION

INSTALLATION ENVIRONMENT

When choosing the site in which to install the UPS and the Battery Cabinet, the following points should be taken into consideration:

- Avoid dusty environments
- Check that the floor is level and capable of withstanding the weight of the UPS and the Battery Cabinet
- Avoid cramped environments that could impede the normal maintenance activities
- The relative humidity should not exceed 90%, non-condensing
- Avoid installing the equipment in places exposed to the direct sunlight or hot air
- This equipment is intended for use in a controlled environment, hence the temperature must be regulated within a range between 0 and 40°C



The UPS may be operated within an ambient temperature of between 0 to 40°C. The recommended working temperature for the UPS and batteries is between 20 to 25°C. Please note, if the battery has an average life of 5 years at a working temperature of 20°C, the life is halved if the working temperature is increased to 30°C.

To maintain the temperature of the installation room to within the range indicated above, there must be a system for eliminating the dissipated heat (the UPS kW / kcal/h / B.T.U./h dissipation values are shown in the *Table 2*). The methods that may be used are:

- *Natural ventilation*
- *Forced ventilation*, recommended if the outside temperature is less (e.g. 20°C) than the temperature at which the UPS or Battery Cabinet is to be operated (e.g. 25°C)
- *Air-conditioning system*, recommended if the outside temperature is higher (e.g. 30°C) than the temperature at which the UPS or Battery Cabinet is to be operated (e.g. 25°C)

AMBIENT AND DIMENSION DETAIL Table 1				
		CPT	ACT	XTD
Ambient temperature for the UPS		0 - 40°C		
Recommended temperature for battery life		20 - 25°C		
Range of relative Humidity		5 - 95% (without condensing)		
Maximum Operating Altitude (according with IEC/EN 62040-3)		Full power up to 1000 m a.s.l. (power derating of 0.5% for each 100 m between 1000 and 4000 m)		
Storage Temperature		UPS: -25°C ÷ +60°C Batteries: -15°C ÷ +40°C		
Isolation protection		IP20		IP20 (IP21, IP30, IP31 are available on request)
Colour		RAL 7016	RAL 7016	RAL 7016
Ventilation		Forced, front to rear	Forced, front to rear	Forced, front to rear (Air filter Door as option)
Cable input		Bottom (rear)		
Pollution degree		PD2		
Vibration resistance		1 m/s ²		
Overvoltage category / Protective class		OVC II / class I		
UPS Dimension (WxDxH) [mm]		280 x 840 x 700	380 x 850 x 1025	440 x 840 x 1320
Shipping Weight without batteries [kg]	10 kVA	56	85	123
	15 kVA	58	87	125
	20 kVA	60	89	127
Shipping Weight with full battery configuration [kg]	10 kVA	159	291	432
	15 kVA	161	293	434
	20 kVA	163	295	436
Weight without batteries [kg]	10 kVA	48	72	103
	15 kVA	50	74	105
	20 kVA	52	76	107
Weight with full battery configuration [kg]	10 kVA	151	278	412
	15 kVA	153	280	414
	20 kVA	155	282	416
Battery (maximum quantity that can be housed internally)		Space for: (20+20) 7/9 Ah blocks	Space for: 2 x (20+20) 7/9 Ah blocks	Space for: 3 x (20+20) 7/9 Ah blocks (Output transformer alternative to internal batteries)

		ELECTRICAL INFORMATION TABLE <i>Table 2</i>		
		10 kVA	15 kVA	20 kVA
Power [kVA / kW]		10/10	15/15	20/20
V Input [V]	Three-phase (S3T / S3M)	400 ± 20% (3PH + N)		
	Single-phase (S3M)	230 ± 20% (PH + N)		
Frequency Input [Hz]		50 - 60		
V Output [V]	S3T	380-400-415 (3PH + N)		
	S3M	220-230-240 (PH + N)		
Frequency Output [Hz]		50 / 60		
Power dissipated @ 100% triphase load ⁽¹⁾		0.41 kW 350 kCal/h 1400 B.T.U./h	0.59 kW 505 kCal/h 2000 B.T.U./h	0.84 kW 720 kCal/h 2860 B.T.U./h
Power dissipated @ 100% single-phase load ⁽¹⁾		0.44 kW 375 kCal/h 1485 B.T.U./h	0.62 kW 530 kCal/h 2100 B.T.U./h	0.89 kW 765 kCal/h 3030 B.T.U./h
Flow rate of the fans for removing the heat from the installation room ⁽²⁾ (referred to single-phase)		235 m³/h	330 m³/h	475 m³/h

(1) 3.97 BTU / h = 1 kcal / h

(2) To calculate the air flow rate, the following formula may be used: $Q [m^3/h] = 3.1 \times P_{diss} [Kcal/h] / (t_a - t_e) [^{\circ}C]$

P_{diss} is the power expressed in Kcal/h dissipated by all the devices installed in the installation environment.

t_a = ambient temperature, t_e = outside temperature. To take leaks into account, the value obtained should be increased by 10%.

The table shows an example of a flow rate with $(t_a - t_e) = 5^{\circ}C$ and a rated resistive load ($pf=1$).

(Note: This formula is applicable if $t_a > t_e$, only; if the UPS installation does not require an air-conditioning system).

ELECTROMAGNETIC COMPATIBILITY

This UPS product conforms to the current electromagnetic compatibility (EMC) regulations (C2 class). It may cause radio interference in the home environment. The user may have to adopt supplementary measures.

This product is for professional use in industrial and commercial environments. Connections to USB must be made with the cable provided; the connection to the RS232 (RJ10 connector) have to be made with shielded cables less than 3 metres long.

OVERVOLTAGE PROTECTION

The UPS has been designed to be powered by an AC mains supply with category 2 voltage spikes. If it is connected to an AC supply with different characteristics or if it is potentially subject to even transitory overvoltage, external protection equipment must be installed to it.

PRELIMINARY INFORMATION FOR INSTALLATION

ALL OPERATIONS DESCRIBED IN THIS SECTION MUST BE PERFORMED BY QUALIFIED AND TRAINED PERSONNEL ONLY.



Our Company assumes no liability for damages caused by incorrect connections or operations not described in this manual.



The following operations have to be performed with the UPS disconnected from the power source, switched off and with all equipment switches open.

Before making the connection, open all cabinet switches and verify that the UPS is completely isolated from all power sources: battery and AC power supplies. In particular, check that:

- the UPS input line is completely disconnected
- the UPS bypass line is completely disconnected
- the UPS battery line switch/fuses are open
- all UPS switches are in the open position
- check with a multimeter that there are no dangerous voltages

The first connection to be made is the protective conductor (earth wire), this must be connected to the bolt marked as PE.

The UPS must only be operated whilst connected to a suitable earthing system.

The input Neutral must always be connected.

ATTENTION: a three-phase 4-wire distribution system is required.

The standard UPS version must be connected to a 3 Phase + Neutral + PE (ground protection) power source.

Ensuring that the incoming phase rotation is within a clockwise direction.

ATTENTION: After the installation operations are completed, refit all of the cabinet protection panels using the appropriate screws supplied.

INTERNAL BATTERIES



CAUTION: If the UPS has INTERNAL BATTERIES, follow all the PRECAUTIONS AND SAFETY RULES listed below.

- The UPS has HAZARDOUS electrical voltages inside it, even when the input and/or battery switches are off. The inside of the UPS is protected by safety panels which should not be removed by untrained personnel. All installation and maintenance or operations involving access inside the UPS require the use of tools and may ONLY be performed by trained personnel.
- The UPS contains an internal source of energy: batteries. All terminals and sockets may be live even without connecting the UPS to the mains supply.
- The total battery voltage may be potentially dangerous: it may generate an electric shock. The battery compartment is protected by safety panels which should not be removed by untrained personnel. All installation and maintenance of the batteries involve access inside the UPS and require the use of tools: such operations may ONLY be performed by trained personnel.
- Replaced batteries must be considered TOXIC WASTE and treated accordingly (refer to RAEE-WEEE manual "DISPOSAL OF THE APPLIANCE AND/OR ITS PARTS"). Do not dispose of batteries in a fire: they may explode. Do not attempt to open the batteries: they are maintenance-free. In addition, the electrolyte is harmful to the skin and eyes and can be toxic.
- Do not turn on the UPS if it is leaking fluid or if you see a residual white powder.
- Do not allow water, liquids in general and/or other foreign objects to get inside the UPS.
- Do not open the battery fuse holder while the UPS is powering the load in battery operation mode. The interruption of the battery DC may cause an electrical arc resulting in equipment failure and/or fire. In addition, if there is no mains power, the energy to power the load is provided by the batteries, therefore opening the battery fuses would lead to the shutdown of the load.
- Follow these recommendations when working on the batteries:
 - Remove wristwatches, rings and other metal objects
 - Use tools with insulated handles
 - Wear rubber shoes and gloves
 - Do not lay tools or metal objects on top of the batteries
 - Disconnect the charging source before connecting or disconnecting the battery terminals
- When replacing batteries, use only the same type and number of batteries.



ATTENTION: Risk of explosion if batteries are replaced by an incorrect type

For correct interconnection of the batteries, refer to the wiring diagrams available to service personnel only or to the battery kit installation manual.

BATTERY MAINTENANCE



WARNING: HAZARDOUS VOLTAGE INSIDE!

Never open the cover of the battery compartment for any reason. If any anomaly is noted, please contact the service department.



In order to preserve a high level of efficiency and a good lifespan, the batteries must be periodically charged using the UPS itself.

Batteries are subject to self-discharge. If the internal batteries or the Battery Cabinets are stocked and not immediately installed, a full charge must be performed.

In order to re-charge the batteries, it is required to connect the Battery Cabinet or the batteries internal to the UPS unit for at least 24hrs in "NORMAL MODE" or "STAND-BY CB ON".

If a long battery stocking period is planned, please contact the service department.

EXTERNAL PROTECTIVE DEVICES

RCD BREAKER (RESIDUAL CURRENT DEVICE)

If an input isolation transformer is not present, the neutral from the mains power supply is connected to the UPS output neutral. As a result, there will be no change to the neutral arrangements of the installation:

**THE UPS INPUT NEUTRAL IS CONNECTED TO THE UPS OUTPUT NEUTRAL
THE DISTRIBUTION SYSTEM THAT POWERS THE UPS IS NOT MODIFIED BY THE UPS**



The neutral condition is only modified if an isolation transformer is present or when the UPS works with the neutral isolated upstream.

Make sure that the equipment is properly connected to the input neutral, otherwise serious damage can occur to the UPS.

During normal operation, when the mains supply is present, an RCD breaker at the input of the UPS will activate if a fault occurs at the output side, since the output circuit is not isolated from the input.

In any case, other RCD breakers may still be installed at the output, preferably in coordination with those present at the input.

The earth leakage current may exceed 3.5mA (max 15mA), so the RCD breaker located upstream must have the following characteristics:

- Differential current adjusted to the sum of UPS + Load; we recommend keeping a suitable margin to prevent nuisance tripping (100mA min. - 300mA recommended)
- Type B
- Delay of at least 0.1s

NOTE for DUAL INPUT connection:

1. A single RCD breaker must be installed upstream at the point where the sources divide to supply the standard input and the bypass input of the UPS (refer to *Table 11*).
2. If the standard input and the bypass input are supplied from two separated sources, then it is required to use a dedicated RCD device for each source.

BACKFEED PROTECTION

The UPS has an internal protection against backfeed. This protection acts by means of a sensing circuit which turns the inverter off if a fault within the static switch is detected. During this condition, to avoid interrupting the supply to the connected load, the UPS switches to the bypass line.

If this fault occurs during battery operation, the inverter is stopped.

A volt free contact can be configured to drive a disconnecting device to be installed upstream of the bypass input to the UPS, in this case when a backfeed fault occurs, the system opens the external disconnecting device, hence avoiding the requirement to stop the inverter (refer to the user manual to configure this option).



The label supplied with the UPS named "Risk of Voltage Backfeed" and included in the accessory box, must be affixed to all disconnectors installed within the electrical system upstream of the UPS.

THERMAL-MAGNETIC CIRCUIT BREAKERS

As previously explained, the UPS has protection devices for output faults as well as for internal faults. In order to configure the power source, a thermal-magnetic switch must be installed upstream of the UPS. Please follow the indications in the table below:

Automatic external protective devices Table 3		
UPS model	Mains input	Bypass Input (DI version)
10	40A (trip characteristic curve "C")	40A (trip characteristic curve "C")
15 – 20	50A (trip characteristic curve "D")	50A (trip characteristic curve "D")



If the protective device upstream of the UPS interrupts the neutral wire, it must also interrupt all of the phase wires at the same time (4-pole breaker). Please select the thermal-magnetic circuit breakers in accordance with the "SHORT CIRCUIT WITHSTANDING" below.

Output protections (recommended values for selectivity) Table 4	
Normal fuses (GI)	In (Nominal current)/4
Normal switches (C curve)	In (Nominal current)/4
Ultra-fast fuses (GF)	In (Nominal current)/2

SHORT CIRCUIT PROTECTION

If a failure at the output occurs, the UPS protects itself by limiting the value and duration of the output current (short-circuit current). These values also depend on the operating status of the UPS at the time of the failure; there are two different scenarios:

- UPS in NORMAL OPERATION with a bypass supply: the load is instantly switched to the bypass line ($I^2t = 11250 \text{ A}^2\text{s}$): the input line is connected to the output without any internal protection (blocked after $t > 500\text{ms}$).
- UPS in BATTERY OPERATION or in NORMAL OPERATION without a bypass supply: the UPS protects itself by supplying 2.7 times the nominal current to the output for the first 200ms, which is then reduced to 1.5 times nominal for 300 ms. After this time (500 ms) it switches off.

SHORT CIRCUIT WITHSTANDING

This equipment is rated for use in a circuit capable of delivering no more than 6000 symmetrical amperes (6 kA), at 415V maximum.

INTERNAL PROTECTIVE DEVICES

The table below shows the sizes of the switch disconnectors of the UPS and the sizes of the battery fuses: these devices are accessible either from the front (ACT and XTD versions), or from the rear for the CPT version.

There is also data in relation to the rating of the internal fuses (not accessible) which protect the input and output lines, along with the maximum input and rated output currents.

Fuses must be replaced with ones of the same size and the characteristics as indicated in the table below.

Switches and internal protective devices Table 5						
UPS model	Disconnect switches and fuse holders			Internal Fuses		
	SWIN / SWBYP(*)	SWOUT / SWMB	SWBATT(**)	Rectifier input fuses	Battery stage fuses	Output fuses
10	63A (4P)	63A (4P)	32A gR 500V (10x38)	25A FF 500V (6.3x32)	20A FF 500Vdc (6.3x32)	20A FF 500V (6.3x32)
15	63A (4P)	63A (4P)	50A gR 500V (14x51)	2x25A FF 500V (6.3x32)	32A gR 500V (10x38)	2x20A FF 500V (6.3x32)
20	63A (4P)	63A (4P)	50A gR 500V (14x51)	2x25A FF 500V (6.3x32)	32A gR 500V (10x38)	2x20A FF 500V (6.3x32)

(*) SWBYP: CPT = not available; ACT = optional; XTD: present

(**) Warning: SWBATT disconnect only the batteries contained in the UPS cabinet

POWER CONNECTION INFORMATION

INPUT AC Line Connection 3PH + N + PE

Table 6

UPS size [kVA]	Max current [A]	Terminal L1, L2, L3, N		PE	Suggested wire L1, L2, L3, N, PE (*)		
		Maximum cross section [sqmm]	Max Tightening torque [Nm]		Cross sectional area L1, L2, L3 [N x sqmm]	Cross sectional area N, PE (**) [N x sqmm]	Type
10	21	10	1.9	M6	1 x 2.5	1 x 4	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
15	31.5	16	3	M6	1 x 4	1 x 6	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
20	40	16	3	M6	1 x 6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)

BYPASS AC Line Connection 3PH + N + PE (Dual Input)

Table 7

UPS size [kVA]	Max Continuous current [A]	Terminal L1B, L2B, L3B, N		PE	Suggested wire L1B, L2B, L3B, N, PE (*)		
		Maximum cross section [sqmm]	Tightening torque [Nm]		Cross sectional area L1B, L2B, L3B [N x sqmm]	Cross sectional area N, PE (**) [N x sqmm]	Type
10	16	10	1.9	M6	1 x 2.5	1 x 4	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
15	24	16	3	M6	1 x 4	1 x 6	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
20	32	16	3	M6	1 x 6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)

OUTPUT AC Line Connection 3PH + N + PE

Table 8

UPS size [kVA]	Nominal current In [A]	Terminal L1, L2, L3, N		PE	Suggested wire L1, L2, L3, N, PE (*)		
		Maximum cross section [sqmm]	Tightening torque [Nm]		Cross sectional area L1, L2, L3 [N x sqmm]	Cross sectional area N, PE (**) [N x sqmm]	Type
10	14.5	10	1.9	M6	1 x 2.5	1 x 4	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
15	22	16	3	M6	1 x 4	1 x 6	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
20	29	16	3	M6	1 x 6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)

Input Battery DC Line Connection BATT+, BATT-, BATT N, PE (Nominal voltage +240V, -240V)

Table 9

UPS size [kVA]	Rated Current [A]		Terminal BATT +, BATT -, BATT N		PE	Suggested wire BATT +, BATT -, BATT N, PE (*)	
	@nominal battery voltage	@end of discharge voltage	Maximum cross section [sqmm]	Tightening torque [Nm]		Cross sectional area +, -, N, PE (**) [N x sqmm]	Type
10	22	27.5	10	1.9	M6	1 x 6	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
15	33	41	16	3	M6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
20	44	55	16	3	M6	1 x 16	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)

(*) The suggested cross section refers to 90°C rated cables with an ambient temperature of 30°C. If different cables are used, or installed at a higher ambient temperature, the cable size needs to be reviewed.

The cross sections indicated in the table refer to a maximum length of 10 metres

(**) We recommend using at least two PE connection cables. If only one cable is used, it must have a minimum section of 10 mm².

ELECTRICAL CONNECTIONS (S3T)



WARNING: a 4-wire three-phase distribution system is required.

The UPS must be connected to a power supply source providing 3-phase + neutral + PE (protective earth) of a TT, TN or IT type. The phase rotation must be correct.

In the IT system a 4-pole thermal-magnetic circuit breaker is mandatory.

Optional TRANSFORMER BOXES to convert the distribution systems from 3-wire to 4-wire are available upon request.

WIRING DIAGRAMS FOR CONNECTING TO THE ELECTRICAL SYSTEM

UPS without any variation in the neutral condition	UPS w/o any variation in the neutral condition and a Dual Input option
UPS with galvanic isolation at the output	UPS with galvanic isolation at the output and a Dual Input option
UPS with galvanic isolation at the input	UPS with galvanic isolation and a Dual Input option

* LVS: low voltage source

Table 10

Dual Input:

If the Dual Input option is present and the bypass is supplied from a separate low voltage source, protective devices must be present on both the main input supply and the bypass supply.

Note: the neutral of the input and the bypass supplies are connected together inside the equipment, therefore they must be referenced to the same potential. If the two power supplies are different, an isolation transformer has to be used on either of the two inputs.

UPS with galvanic isolation	
UPS with galvanic isolation at the input	UPS with galvanic isolation at the Bypass input

* LVS1: low voltage source 1; LVS2: low voltage source 2;

Table 11

EXTERNAL PROTECTIVE DEVICES

RCD BREAKER (RESIDUAL CURRENT DEVICE)

If an input isolation transformer is not present, the neutral from the mains power supply is connected to the UPS output neutral. As a result, there will be no change to the neutral arrangements of the installation:

**THE UPS INPUT NEUTRAL IS CONNECTED TO THE UPS OUTPUT NEUTRAL
THE DISTRIBUTION SYSTEM THAT POWERS THE UPS IS NOT MODIFIED BY THE UPS**



*The neutral condition is only modified if an isolation transformer is present or when the UPS works with the neutral isolated upstream.
Make sure that the equipment is properly connected to the input neutral, otherwise serious damage can occur to the UPS.*

During normal operation, when the mains supply is present, an RCD breaker at the input of the UPS will activate if a fault occurs at the output side, since the output circuit is not isolated from the input.

In any case, other RCD breakers may still be installed at the output, preferably in coordination with those present at the input. The earth leakage current may exceed 3.5mA (max 15mA), so the RCD breaker located upstream must have the following characteristics:

- Differential current adjusted to the sum of UPS + Load; we recommend keeping a suitable margin to prevent nuisance tripping (100mA min. - 300mA recommended)
- Type B
- Delay of at least 0.1s

NOTE for DUAL INPUT connection:

1. A single RCD breaker must be installed upstream at the point where the sources divide to supply the standard input and the bypass input of the UPS (refer to 22).
2. If the standard input and the bypass input are supplied from two separated sources, then it is required to use a dedicated RCD device for each source.

BACKFEED PROTECTION

The UPS has an internal protection against backfeed. This protection acts by means of a sensing circuit which turns the inverter off if a fault within the static switch is detected. During this condition, to avoid interrupting the supply to the connected load, the UPS switches to the bypass line.

If this fault occurs during battery operation, the inverter is stopped.

A volt free contact can be configured to drive a disconnecting device to be installed upstream of the bypass input to the UPS, in this case when a backfeed fault occurs, the system opens the external disconnecting device, hence avoiding the requirement to stop the inverter (refer to the user manual to configure this option).



The label supplied with the UPS named "Risk of Voltage Backfeed" and included in the accessory box, must be affixed to all disconnectors installed within the electrical system upstream of the UPS.

THERMAL-MAGNETIC CIRCUIT BREAKERS

As previously explained, the UPS has protection devices for output faults as well as for internal faults.

In order to configure the power source, a thermal-magnetic switch must be installed upstream of the UPS.

Please follow the indications in the table below:

	Automatic external protective devices			Table 12
UPS Model	Mains input		Bypass Input (P+N)	
	Single-phase input (P+N)	Three-phase input (3P+N)		
10	80A (trip characteristic curve “C”)	63A (trip characteristic curve “C”)	N.D.	
15	100A (trip characteristic curve “C”)	100A (trip characteristic curve “C”)	N.D.	
20	125A (trip characteristic curve “C”)	100A (trip characteristic curve “C”)	N.D.	
10 - UPS with Dual Input	80A (trip characteristic curve “C”)	40A (trip characteristic curve “C”)	63A (trip characteristic curve “C”)	
15 – UPS with Dual Input	100A (trip characteristic curve “C”)	50A (trip characteristic curve “D”)	100A (trip characteristic curve “C”)	
20 - UPS with Dual Input	125A (trip characteristic curve “C”)	50A (trip characteristic curve “D”)	100A (trip characteristic curve “C”)	



If the protective device upstream of the UPS interrupts the neutral wire, it must also interrupt all of the phase wires at the same time (4-pole breaker).
Please select the thermal-magnetic circuit breakers in accordance with the "SHORT CIRCUIT WITHSTANDING" below.

Output protections (recommended values for selectivity)		Table 13
Normal fuses (GI)	In (Nominal current)/4	
Normal switches (C curve)	In (Nominal current)/4	
Ultra-fast fuses (GF)	In (Nominal current)/2	

SHORT CIRCUIT PROTECTION

If a failure at the output occurs, the UPS protects itself by limiting the value and duration of the output current (short-circuit current). These values also depend on the operating status of the UPS at the time of the failure; there are two different scenarios:

- UPS in NORMAL OPERATION with a bypass supply: the load is instantly switched to the bypass line (I^2t see table below): the input line is connected to the output without any internal protection (blocked after $t > 500\text{ms}$).

UPS (kVA)	I^2t [A^2s]	Table 14
10	20000	
15- 20	35000	

- UPS in BATTERY OPERATION or in NORMAL OPERATION without a bypass supply: the UPS protects itself by supplying 2.7 times the nominal current to the output for the first 200ms, which is then reduced to 1.5 times nominal for 300 ms. After this time (500 ms) it switches off.

SHORT CIRCUIT WITHSTANDING

This equipment is rated for use in a circuit capable of delivering no more than the current as per the table below at 240V maximum.

UPS (kVA)	Short circuit symmetrical amperes WITHSTANDING	Table 15
10	6000 (6 kA)	
15- 20	10000 (10 kA)	

INTERNAL PROTECTIVE DEVICES

The table below shows the sizes of the switch disconnectors of the UPS and the sizes of the battery fuses: these devices are accessible either from the front (ACT and XTD versions), or from the rear for the CPT version.

There is also data in relation to the rating of the internal fuses (not accessible) which protect the input and output lines, along with the maximum input and rated output currents.

Fuses must be replaced with ones of the same size and the characteristics as indicated in the table below.

Switches and internal protective devices								Table 16
UPS model	Disconnect switches and fuse holders			Internal Fuses				
	SWIN	SWOUT / SWBYP(*) / SWMB	SWBATT(**)	Rectifier input fuses		Battery stage fuses	Output fuses	
				3P+N	P+N			
10	63A (4P)	63A (2P)	32A gG 400V (10x38)	25A FF 500V (6.3x32)	3x25A FF 500V (6.3x32)	20A FF 500Vdc (6.3x32)	4x20A FF 500V (6.3x32)	
15	125A (4P)	100A (2P)	50A gG 400V (14x51)	2x25A FF 500V (6.3x32)	6x25A FF 500V (6.3x32)	32A gR 500V (10x38)	6x20A FF 500V (6.3x32)	
20	125A (4P)	100A (2P)	50A gG 400V (14x51)	2x25A FF 500V (6.3x32)	6x25A FF 500V (6.3x32)	32A gR 500V (10x38)	6x20A FF 500V (6.3x32)	

(*) SWBYP: CPT = not available; ACT = optional; XTD: present

(**) Warning: SWBATT disconnect only the batteries contained in the UPS cabinet

POWER CONNECTION INFORMATION

INPUT AC Line Connection 3PH + N + PE								Table 17
UPS size [kVA]	Max current [A]		Terminal L1, L2, L3, N		PE	Suggested wire L1, L2, L3, N, PE (*)		
	PH + N connection	3PH + N connection	Max cross section [sqmm]	Max Tightening torque [Nm]	Bolt size	Cross sectional area L2, L3 [N x sqmm]	Cross sectional area L1, N, PE (**) [N x sqmm]	Type
10	63	21	16	3	M6	1 x 2.5	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
15	94.5	31.5	35	5	M6	1 x 4	1 x 16	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)
20	120	40	35	5	M6	1 x 6	1 x 25	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)

BYPASS AC Line Connection PH + N + PE (Dual Input)							Table 18
UPS size [kVA]	Max Continuous current [A]	Terminal L1B, N		PE	Suggested wire L1B, N, PE (*)		
		Maximum cross section [sqmm]	Tightening torque [Nm]	Bolt size	Cross sectional area L1B, N, PE (**) [N x sqmm]	Type	
10	48	16	3	M6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	
15	72	35	5	M6	1 x 16	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	
20	96	35	5	M6	1 x 25	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	

OUTPUT AC Line Connection PH + N + PE							Table 19
UPS size [kVA]	Nominal current In [A]	Terminal L, N		PE	Suggested wire L, N, PE (*)		
		Maximum cross section [sqmm]	Tightening torque [Nm]	Bolt size	Cross sectional area L, N, PE (**) [N x sqmm]	Type	
10	43.5	16	3	M6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	
15	65.2	35	5	M6	1 x 16	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	
20	87	35	5	M6	1 x 25	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	

Input Battery DC Line Connection BATT+, BATT-, BATT N, PE (Nominal voltage +240V, -240V)								Table 20
UPS size [kVA]	Rated Current [A]		Terminal BATT +, BATT -, BATT N		PE	Suggested wire BATT +, BATT -, BATT N, PE (*)		
	@nominal battery voltage	@end of discharge voltage	Maximum cross section [sqmm]	Tightening torque [Nm]	Bolt size	Cross sectional area +, -, N, PE (**) [N x sqmm]	Type	
10	22	27.5	10	1.9	M6	1 x 6	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	
15	33	41	16	3	M6	1 x 10	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	
20	44	55	16	3	M6	1 x 16	FG16R16-0,6/1 kV (90°C) or FG7R (90°C)	

(*) The suggested cross section refers to 90°C rated cables with an ambient temperature of 30°C. If different cables are used, or installed at a higher ambient temperature, the cable size needs to be reviewed.
The cross sections indicated in the table refer to a maximum length of 10 metres

(**) We recommend using at least two PE connection cables. If only one cable is used, it must have a minimum section of 10 mm².

ELECTRICAL CONNECTIONS (S3M)



WARNING: a 4-wire three-phase distribution system is required.

The UPS must be connected to a power supply source providing 3-phase + neutral + PE (protective earth) of a TT, TN or IT type. The phase rotation must be correct.

In the IT system a 4-pole thermal-magnetic circuit breaker is mandatory.

Optional TRANSFORMER BOXES to convert the distribution systems from 3-wire to 4-wire are available upon request.

WIRING DIAGRAMS FOR CONNECTING TO THE ELECTRICAL SYSTEM

NOTE: within the following diagrams, the symbol /// denotes a three-phase connection and the symbol --- denotes a single-phase connection.

UPS without any variation in the neutral condition	UPS w/o any variation in the neutral condition and a Dual Input option
UPS with galvanic isolation at the output	UPS with galvanic isolation at the output and a Dual Input option
UPS with galvanic isolation at the input	UPS with galvanic isolation and a Dual Input option

* LVS: low voltage source

Table 21

Dual Input:

If the Dual Input option is present and the bypass is fed by a separate low voltage source, protective devices must be present on both the main input line and the bypass line.


Note: the neutral of the input line and that of the bypass are commoned inside the equipment, so they must refer to the same potential. If the two power supplies are different, an isolation transformer has to be used on either of the inputs.

UPS with galvanic isolation	
UPS with galvanic isolation at the input	UPS with galvanic isolation at the Bypass input

* LVS1: low voltage source 1; LVS2: low voltage source 2;

Table 22

UPS MODELS

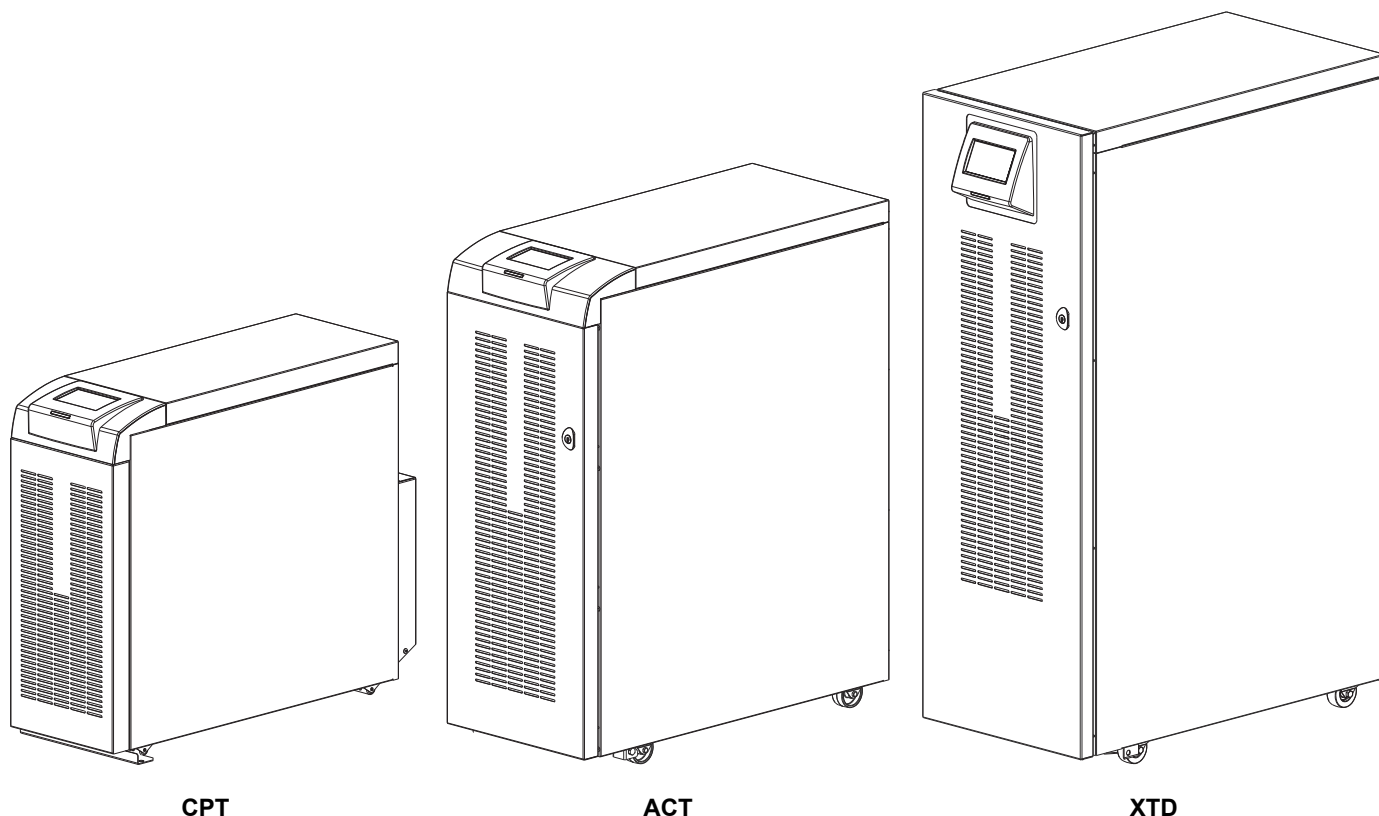

NOTE: some images contained in this document are for information purposes only and may not faithfully demonstrate the parts of the product they represent.

UPS CABINET POSITIONING

When positioning, take into account that:

- the wheels are to be used for final positioning only. Suitable moving equipment must be used to transport the UPS near to the final position.
- plastic parts and the door are not able to act as pushing points or handles.
- Ensure that there is sufficient free space in front of the UPS for user operation and maintenance (≈ 1.5 m).
- no objects should be placed on the upper part of the UPS.



WARNING!

The UPS must be positioned on a level floor.

Ensure that the floor can support the total weight of the system (refer to the *Table 1* within "INSTALLATION ENVIRONMENT").

If side access isn't available take care during the installation to leave sufficient cable to pull the UPS out for maintenance purposes.

Do not place any objects on the top. Do not climb up on the UPS. The chassis isn't designed to hold up the weight of a person.

After positioning, if required, re-use the bracket which fastened the UPS to the pallet to anchor the UPS to the floor (refer to "POWER CONNECTION INSTALLATION" for details).

This uninterruptible power supply (UPS) conforms to all binding safety and electromagnetic compatibility regulations applicable to this type of product. Compliance with these regulations has been certified by accredited third-party bodies.

In addition to that prescribed in the directives, during the design phase our Company made every effort to assess and eliminate or minimise all risks deriving both from correct use and possible reasonably foreseeable incorrect operations.


Civil society and the institutions place special emphasis on protecting certain categories of people (pregnant women, minors, people with cognitive and/or motor disabilities, people wearing pacemakers).

That being said, despite the fact that the UPS is a product reserved for professional and non-domestic use, the above-mentioned people must not access the areas where the UPS is installed.


Moreover, the UPS must be installed in an area that cannot be accessed by domestic animals or where the latter cannot station in.

CPT


POSITIONING INFORMATION

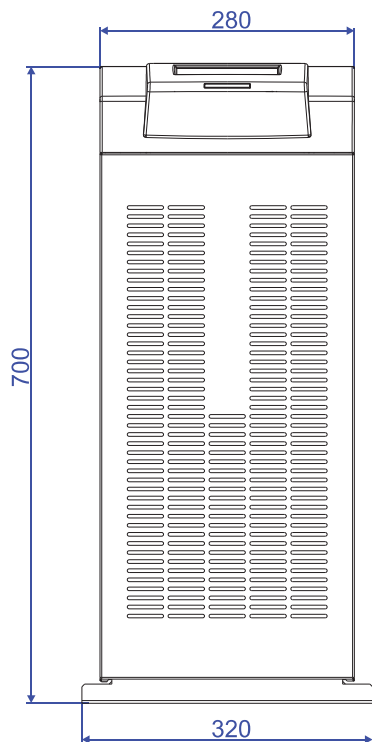


FRONT VIEW

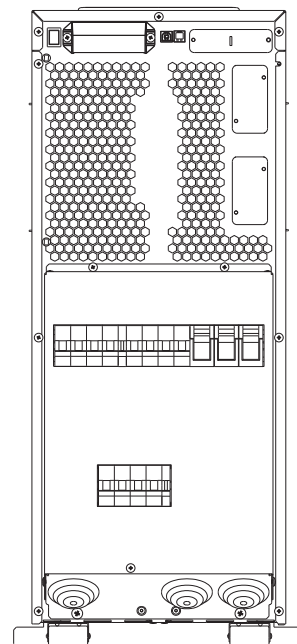


REAR VIEW

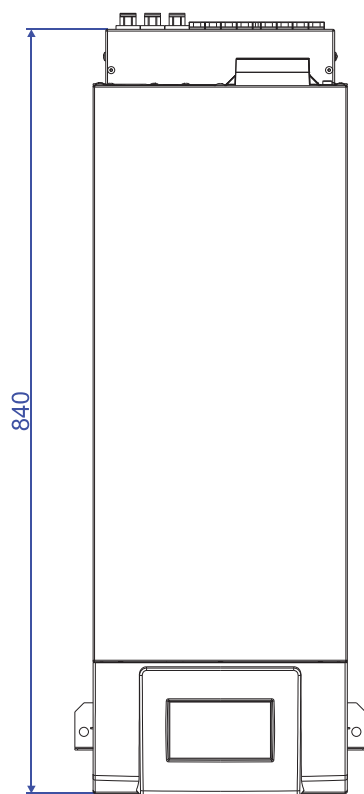

TOP VIEW

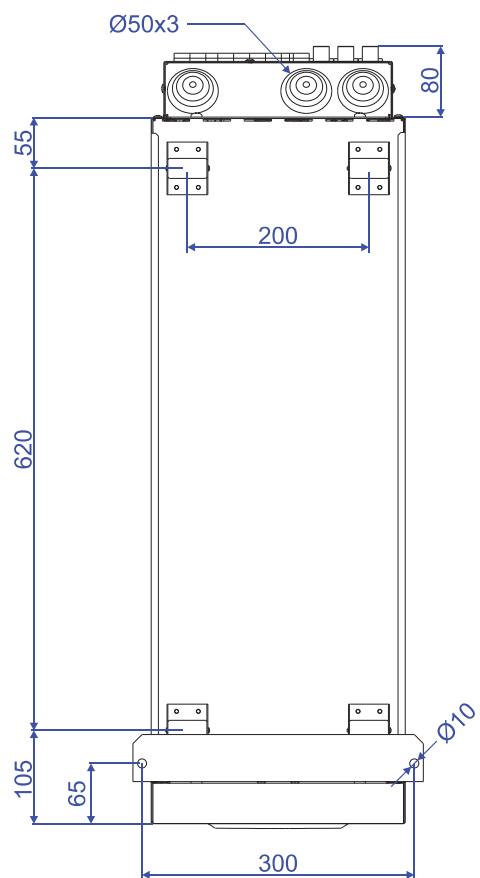


BOTTOM VIEW

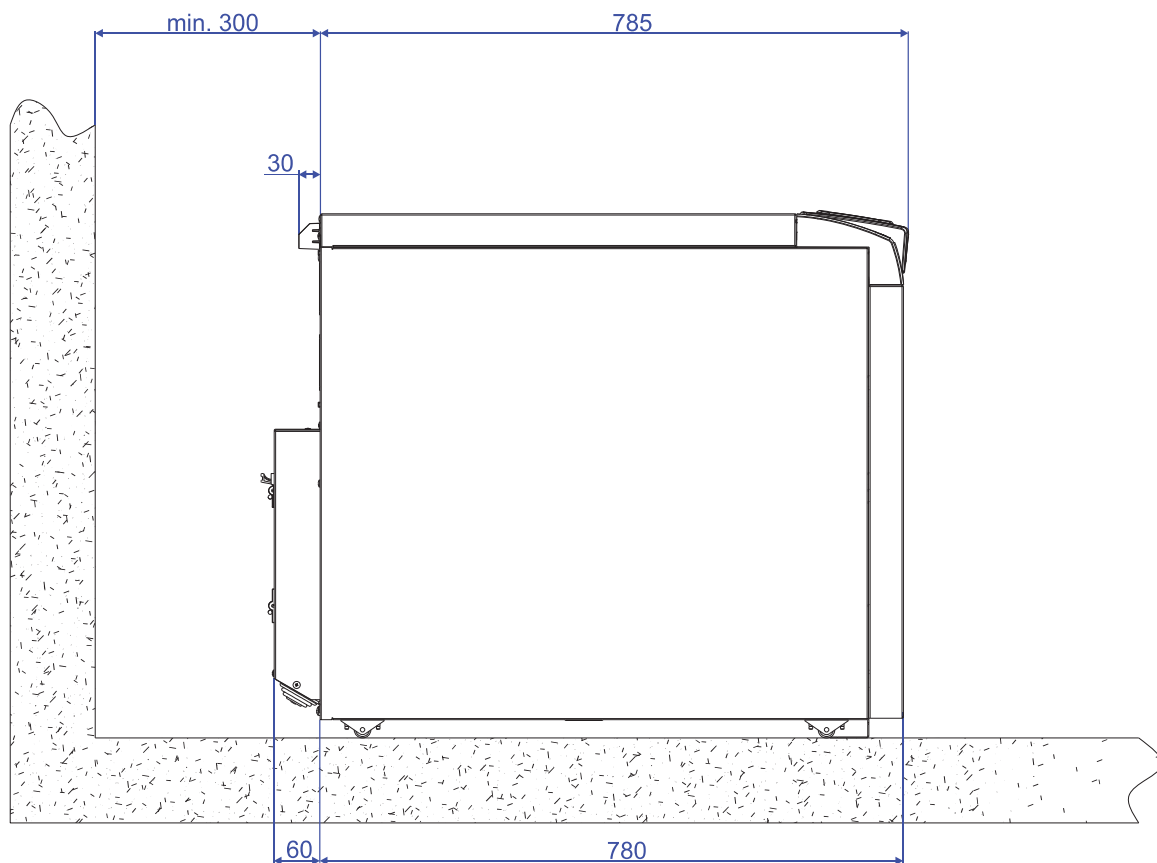


SIDE VIEW


POWER CONNECTION INSTALLATION

PULL TO REMOVE THE FRONT PANEL.
FASTEN THE STABILISING BRACKET USING THE
SCREWS PROVIDED

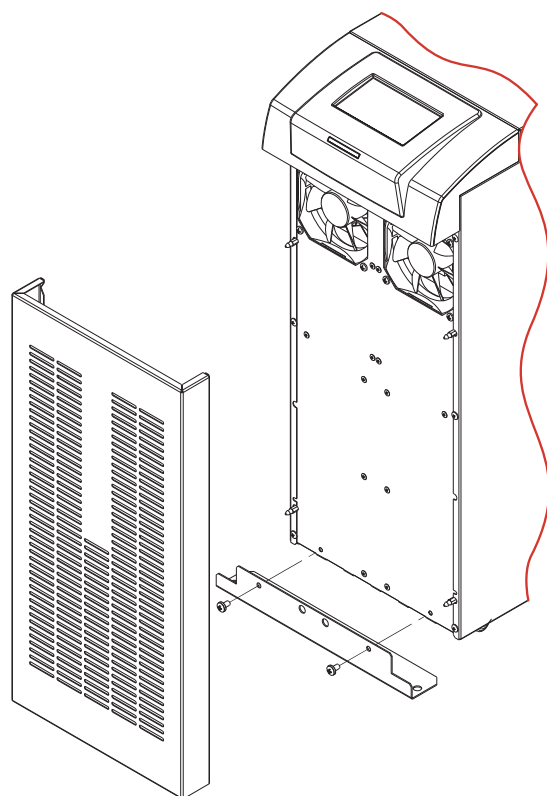


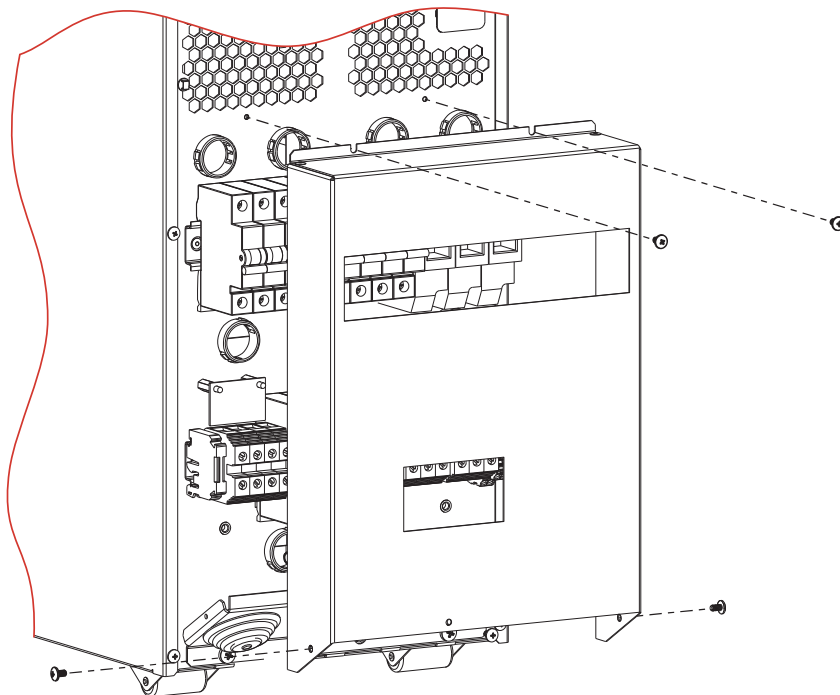

REMOVE THE REAR TERMINAL COVER

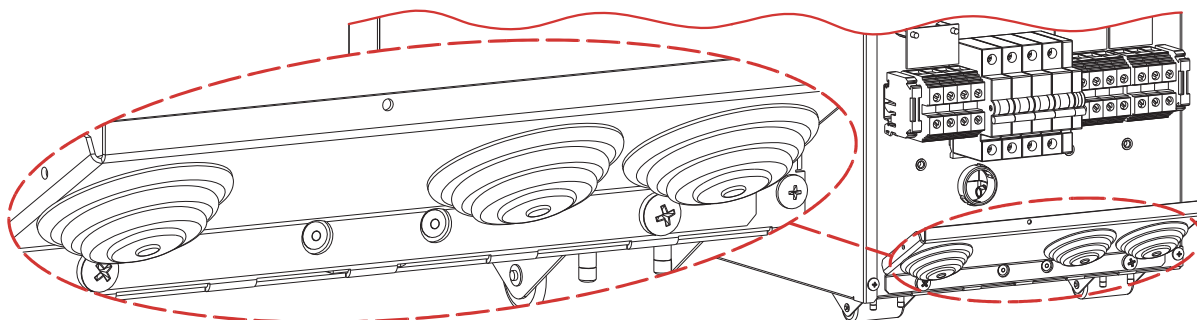


CUT A SUITABLE HOLE IN THE CABLE GLANDS PROVIDED TO MAINTAIN THE REQUIRED DEGREE OF PROTECTION

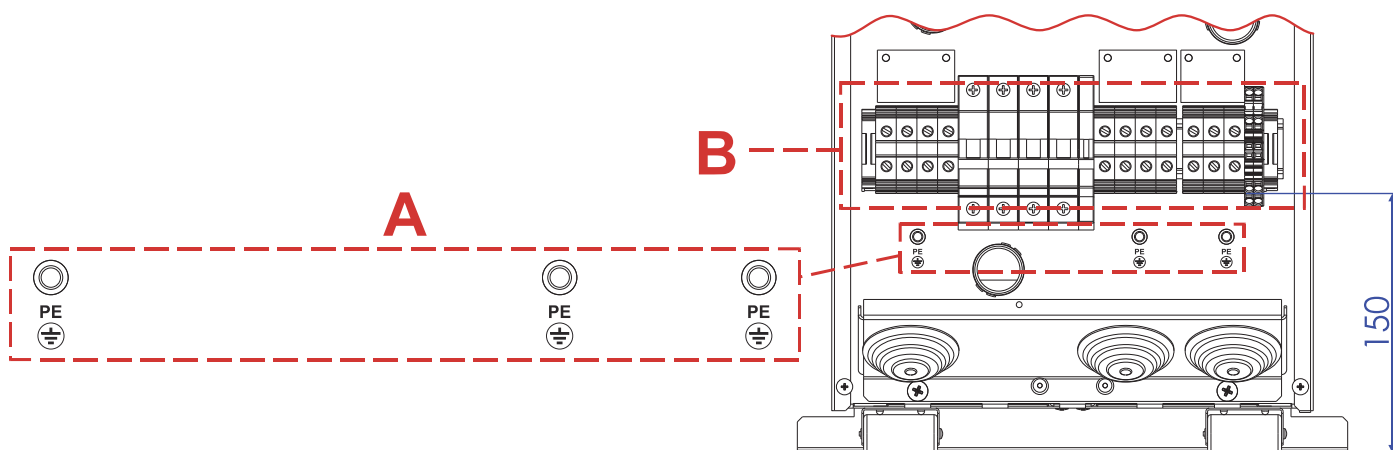

A. PE CONNECTION

B. TERMINAL BLOCKS (FOR MORE INFORMATION REFER TO "POWER CONNECTION DETAILS")

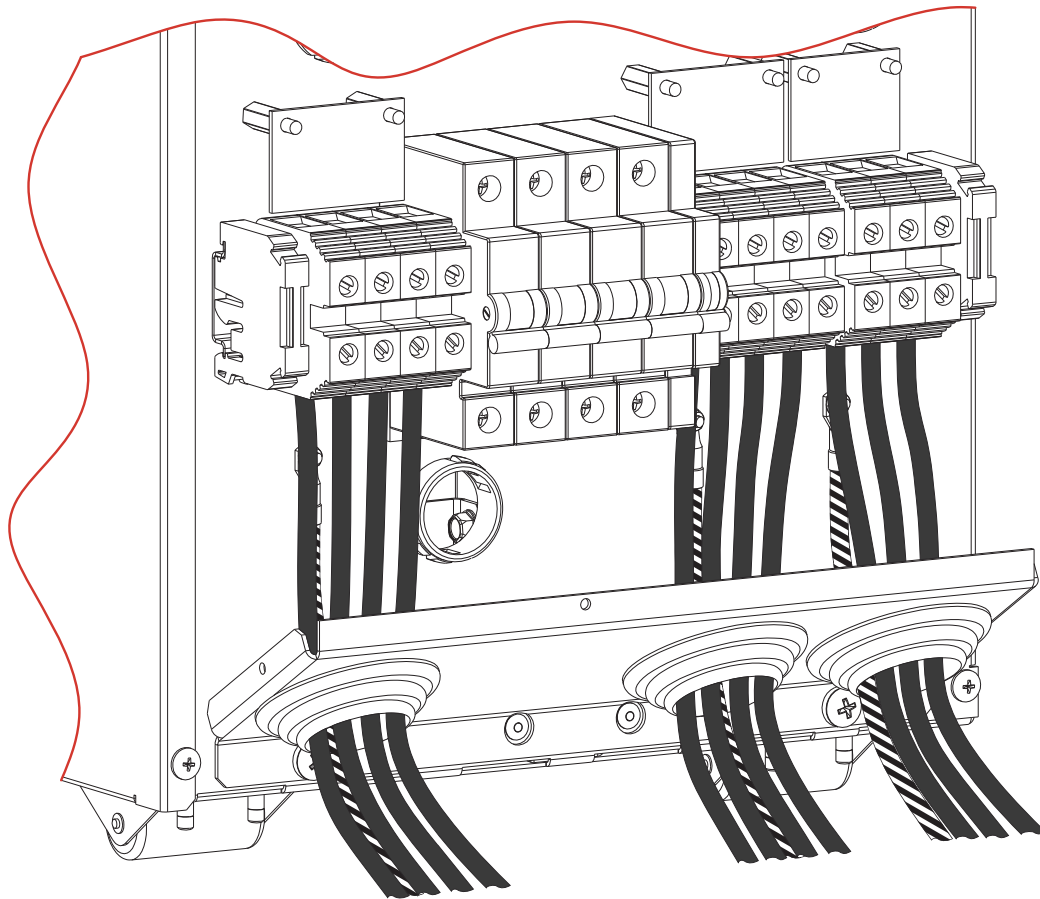


CABLE POSITION DETAIL




It should be recommended to bring each group of cables (Input, Output, Battery) through one hole separately to avoid Eddy Current.

REFIT THE REAR TERMINAL COVER USING THE PREVIOUSLY REMOVED SCREWS.

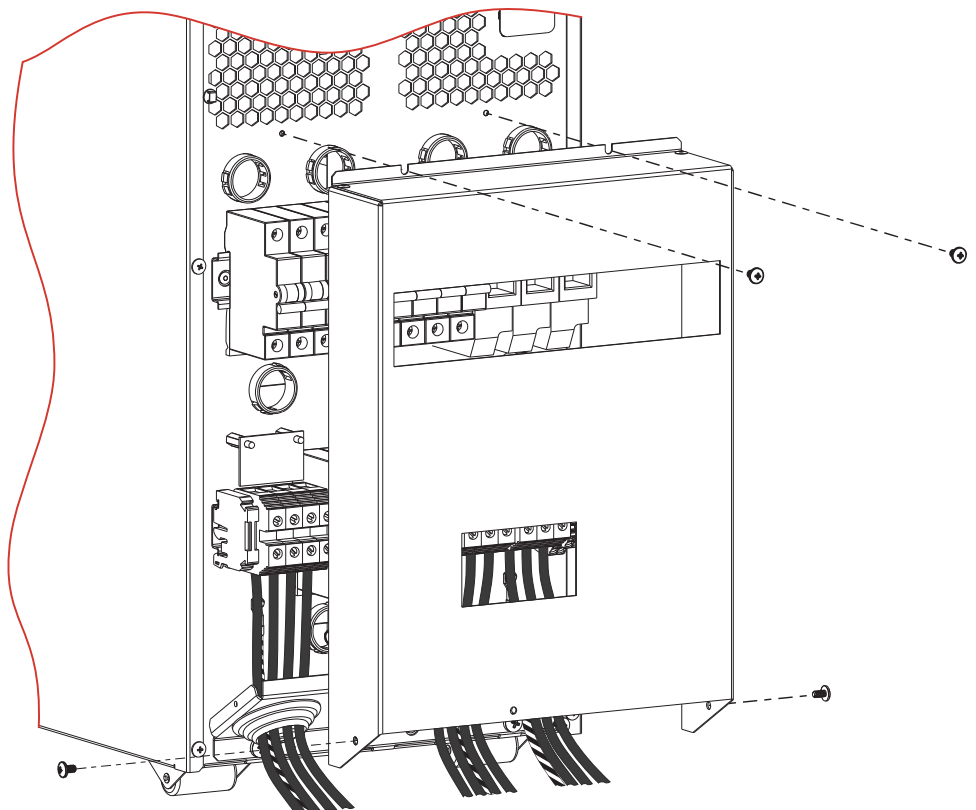


UPS DETAILS

FRONT

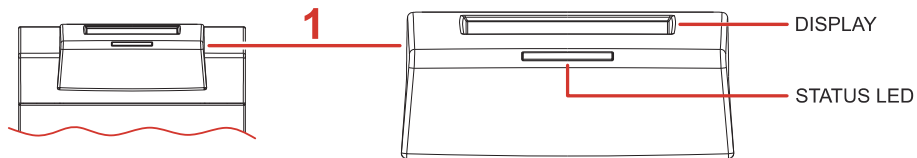

REAR

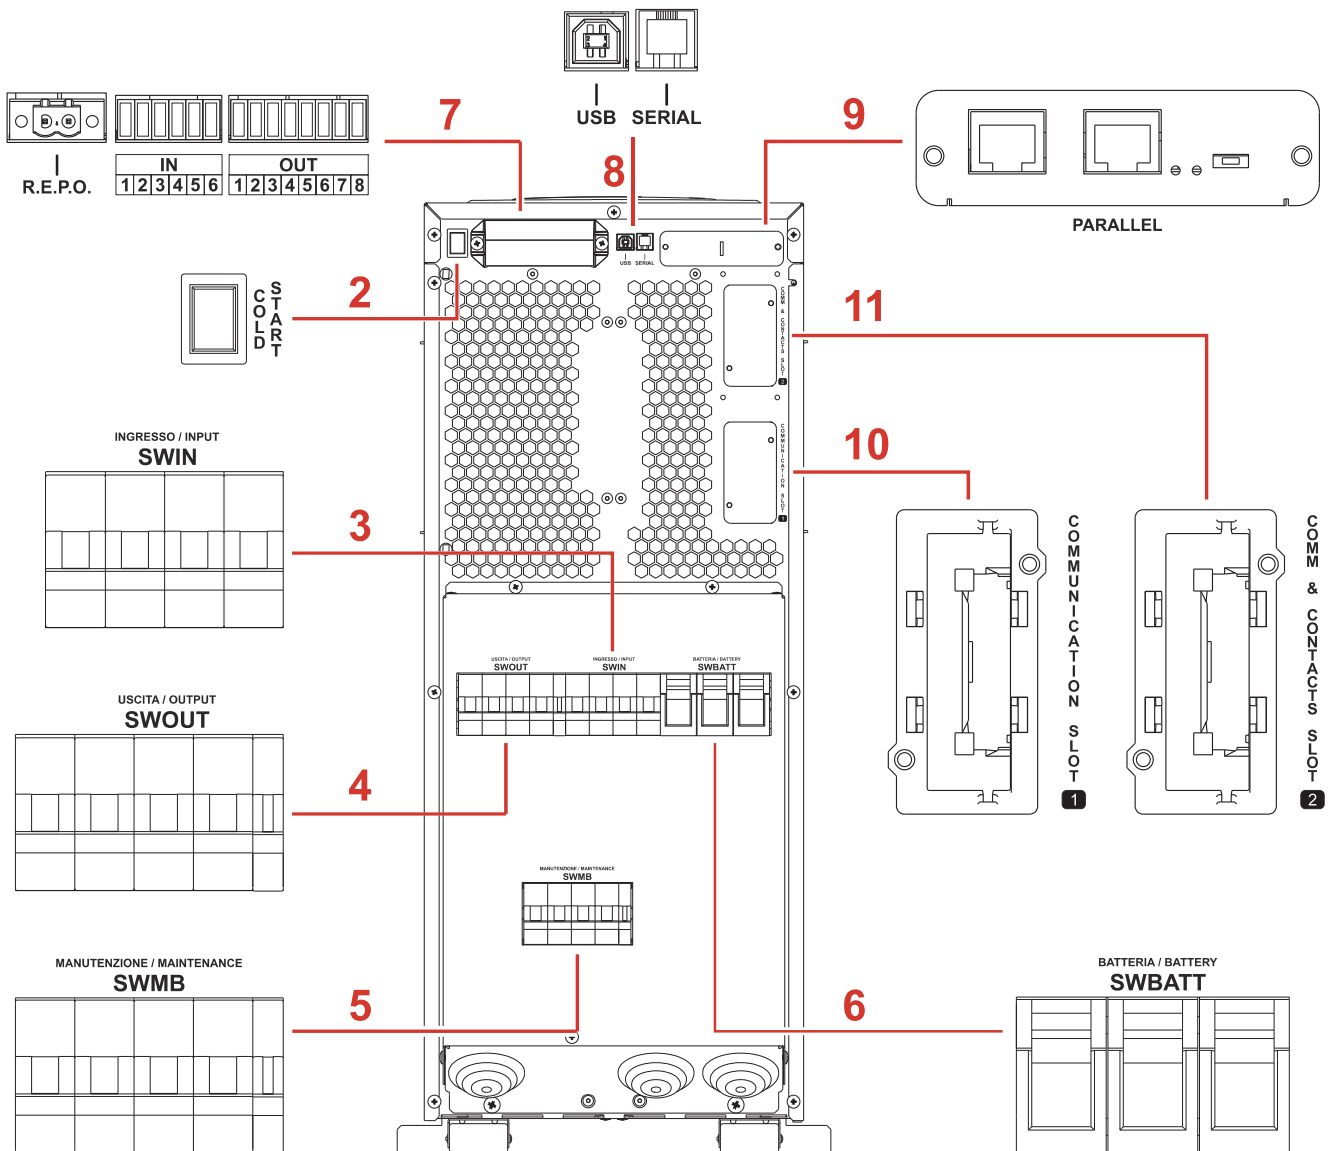

- | | |
|---|--|
| 1. Touch screen display and UPS status LED | 7. Communication ports (R.E.P.O., IN/OUT SIGNAL) |
| 2. Battery start button (COLD START) | 8. Communication ports (USB, SERIAL) |
| 3. Mains input switch (SWIN) | 9. Parallel card (<i>optional</i>) |
| 4. Output switch (SWOUT) | 10. Slot for optional accessory communication cards |
| 5. Manual bypass switch (SWMB) | 11. Slot for optional accessory communication and contacts cards |
| 6. Internal battery fuse holder isolator (SWBATT) | |

POWER CONNECTION DETAILS



The first wire to be connected is the protective earth wire, which is to be inserted in the terminal marked PE. During operation the UPS must be connected to the earthing system.


Connect the input and output cables to the terminal blocks as indicated in the figure below:

TERMINAL BLOCK COLOURS				
RED	BLACK	GREY	BEIGE	BLUE
External battery positive	External battery negative	Input & Bypass Phases	Output Phases	Input, Output and external battery Neutral




THE INPUT NEUTRALS MUST ALWAYS BE CONNECTED.

S3T - THREE PHASE VERSION

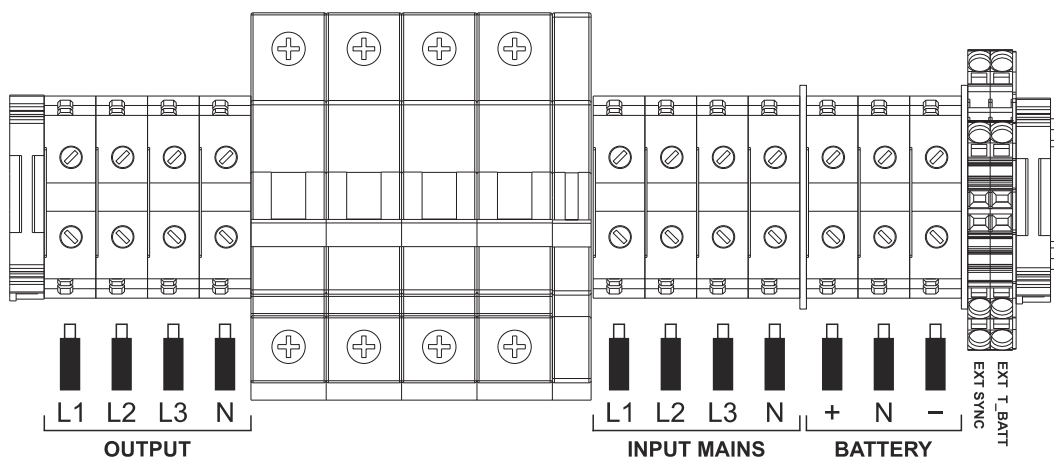

S3M - SINGLE PHASE VERSION

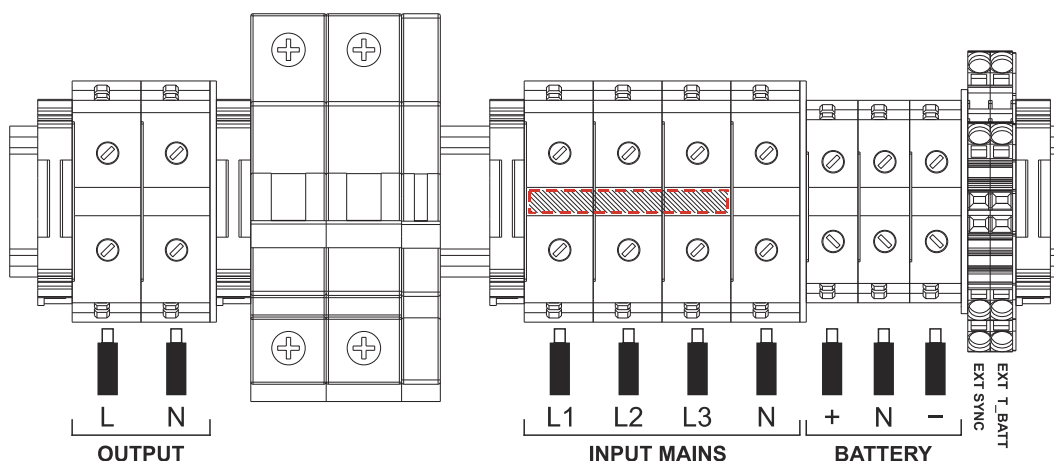

Jumpers (for more details about their installation or removal, refer to "APPENDIX")

To connect a single-phase source to the input: fit the supplied jumper to link the three input terminal blocks, as shown in the image above. The jumper is supplied within the accessories box. Then connect the phase cable to the L1 terminal block.


Note : The S3M 15 – 20kVA has different terminal block colours. For these sizes refer to table below:

TERMINAL BLOCK COLOURS			
RED	BLACK	BEIGE	BLUE
External battery positive	External battery negative	Input and Output connections	External battery Neutral


Note: connection to the BATTERY terminal blocks is only required if an (optional) Battery Cabinet is present.

ACT


POSITIONING INFORMATION

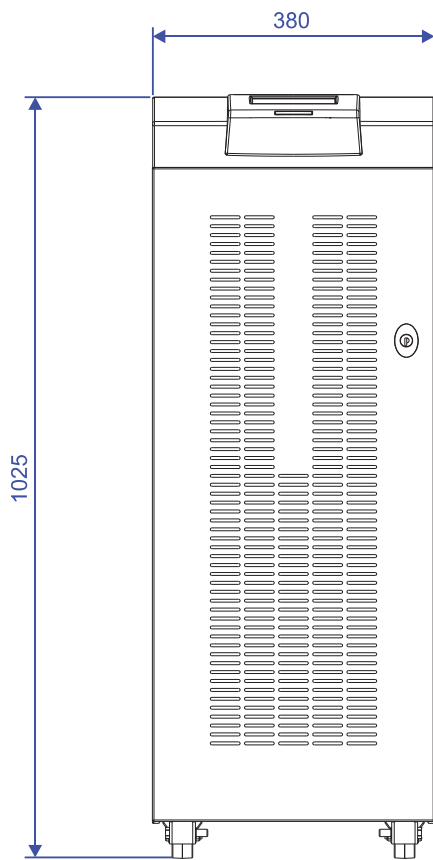


FRONT VIEW

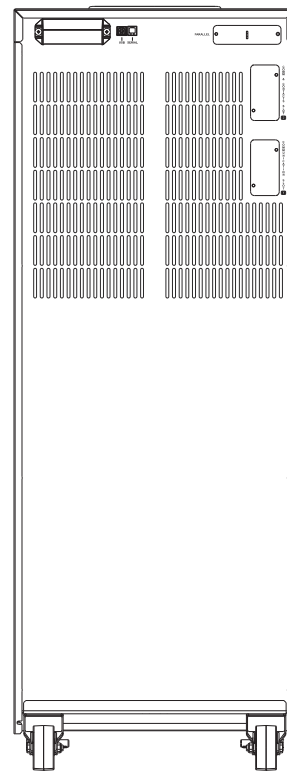


REAR VIEW

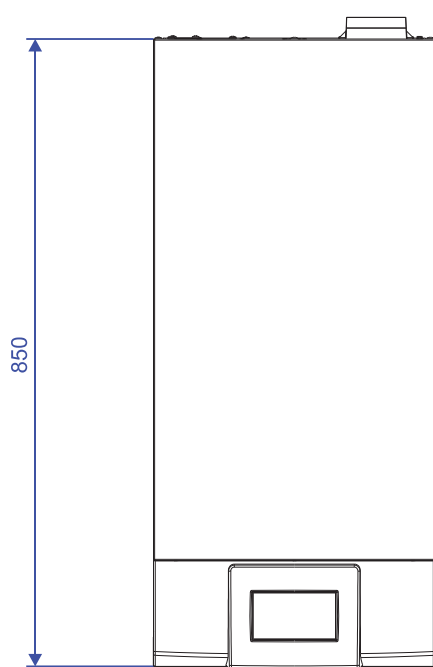

TOP VIEW

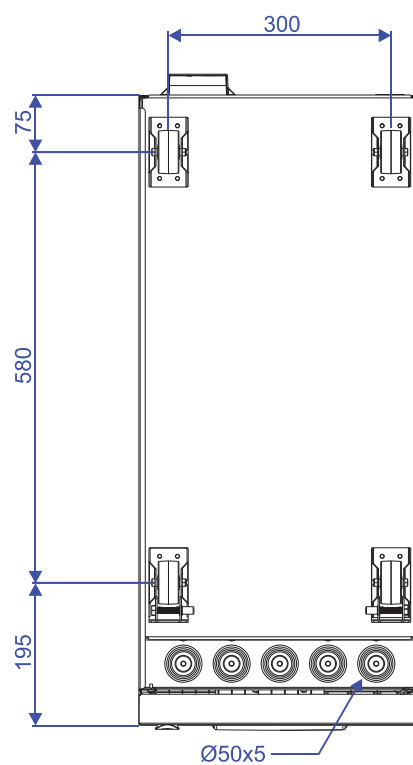


BOTTOM VIEW

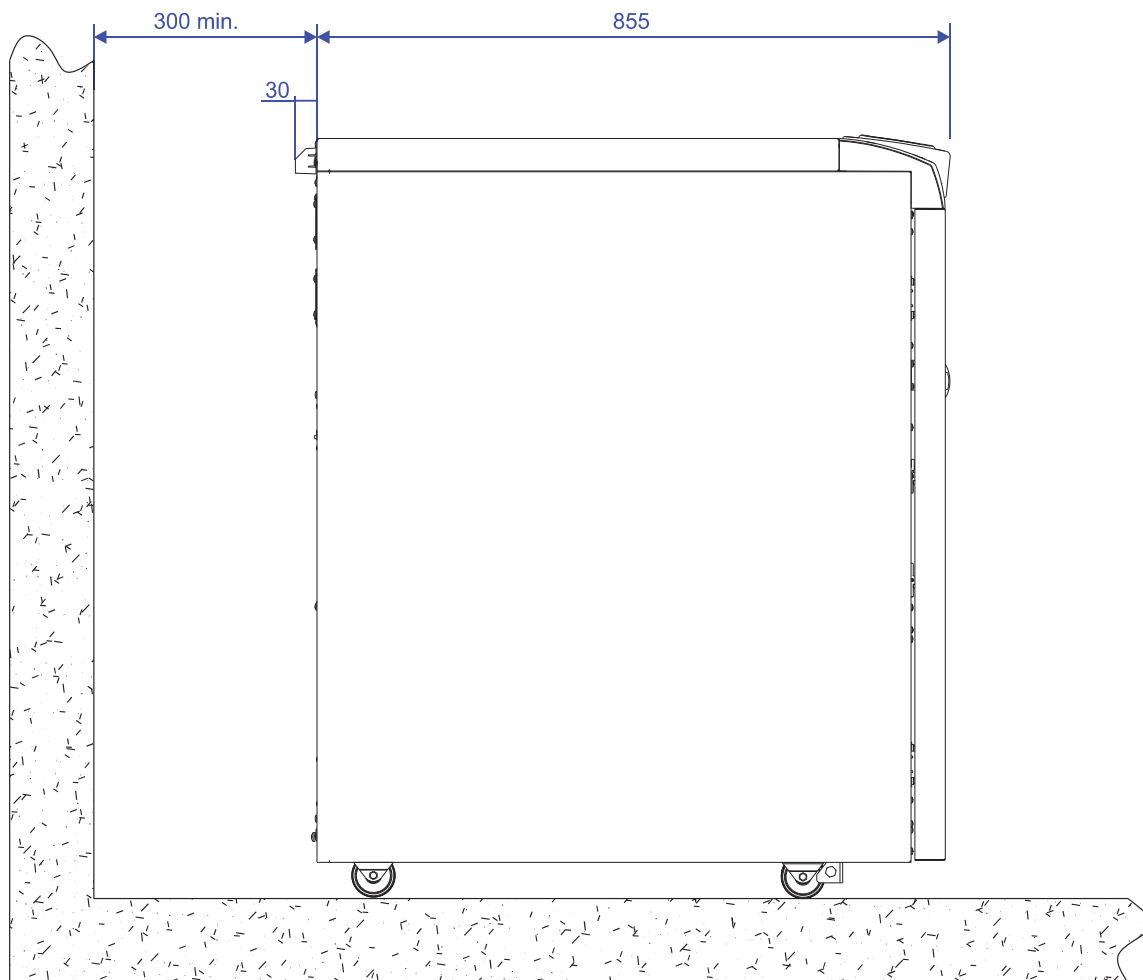



SIDE VIEW

POWER CONNECTION INSTALLATION

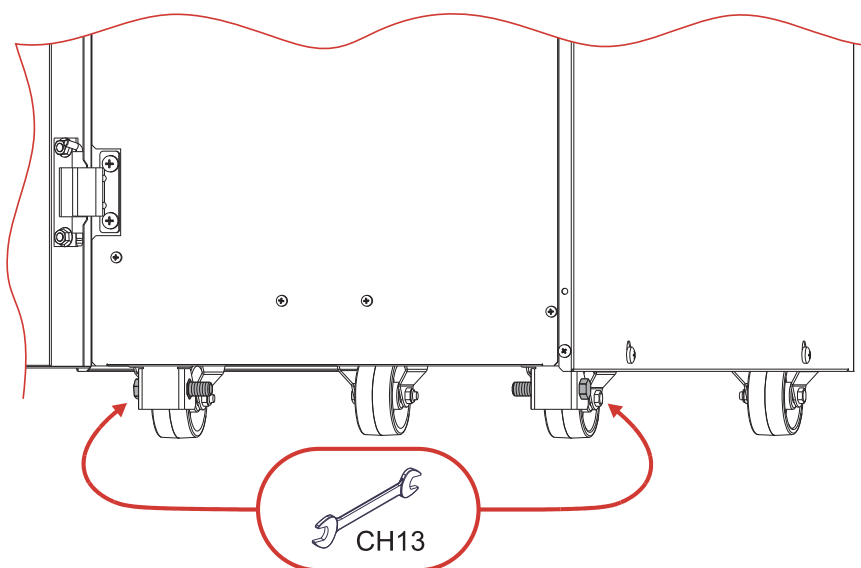


BEFORE ANY OPERATION, LOCK
THE FRONT WHEELS USING THE
SPECIFIC SCREW

REMOVE THE FRONT TERMINAL COVER

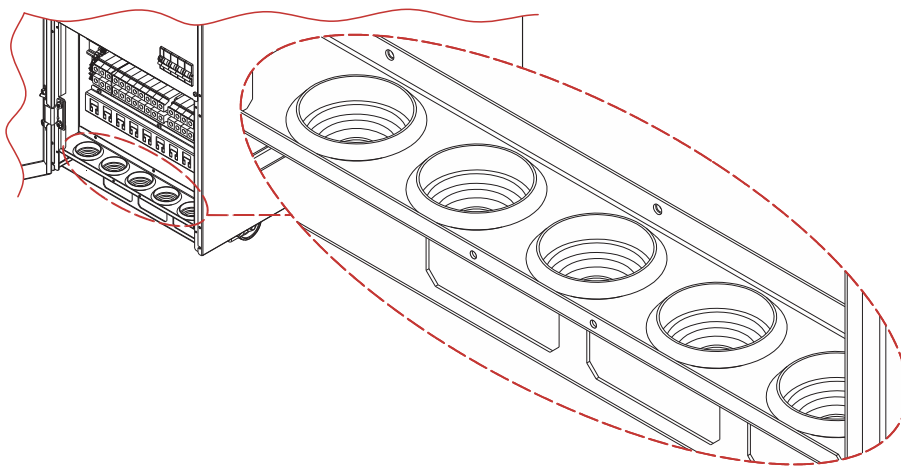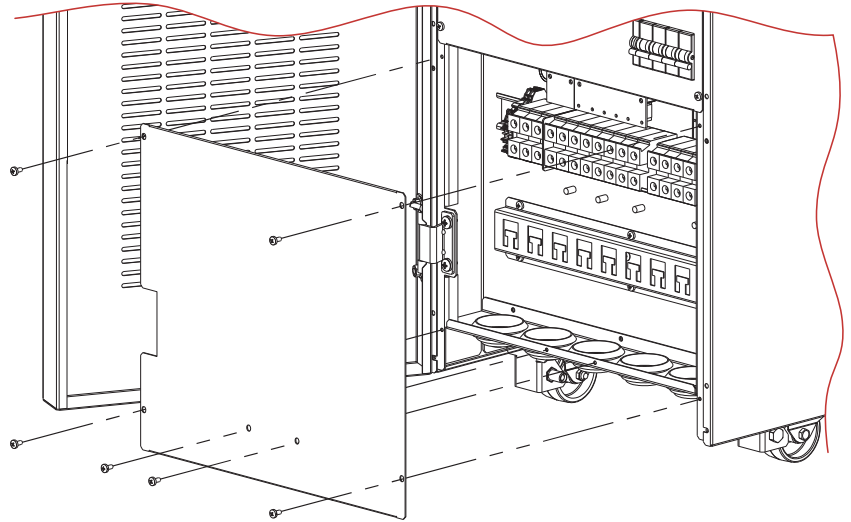


CUT A SUITABLE HOLE IN THE CABLE GLANDS PROVIDED TO MAINTAIN THE REQUIRED DEGREE OF PROTECTION

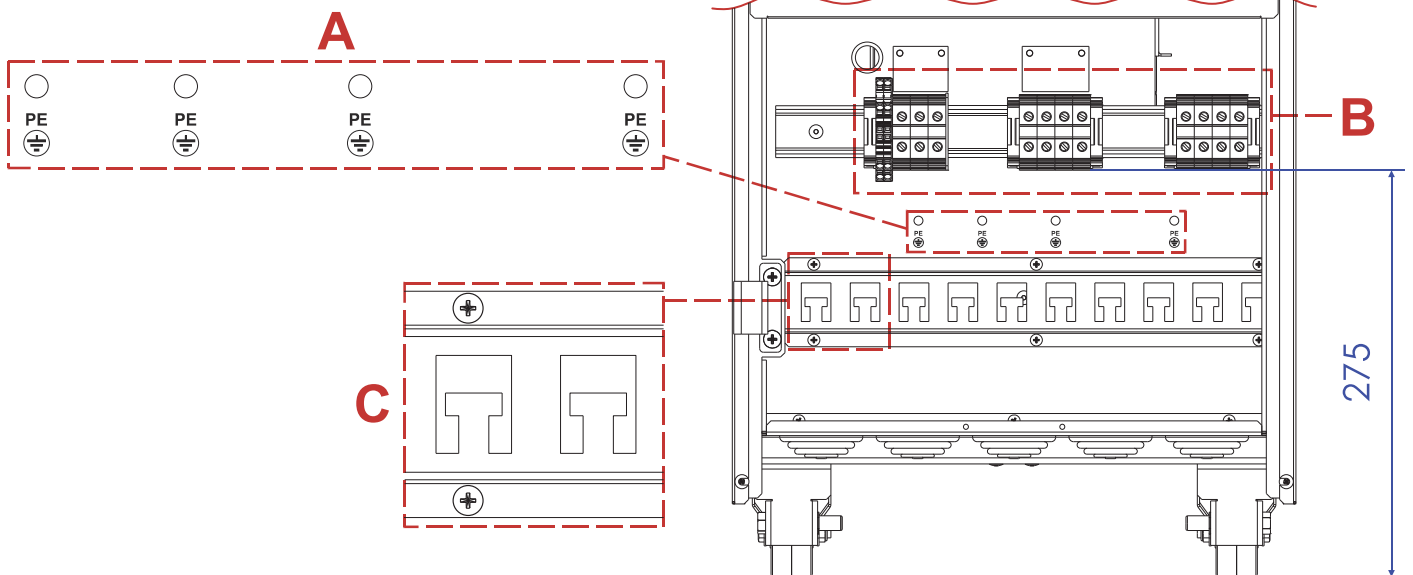

A. PE CONNECTION

B. TERMINAL BLOCKS (FOR MORE INFORMATION REFER TO "POWER CONNECTION DETAILS")

C. CABLE SECURING BRACKET

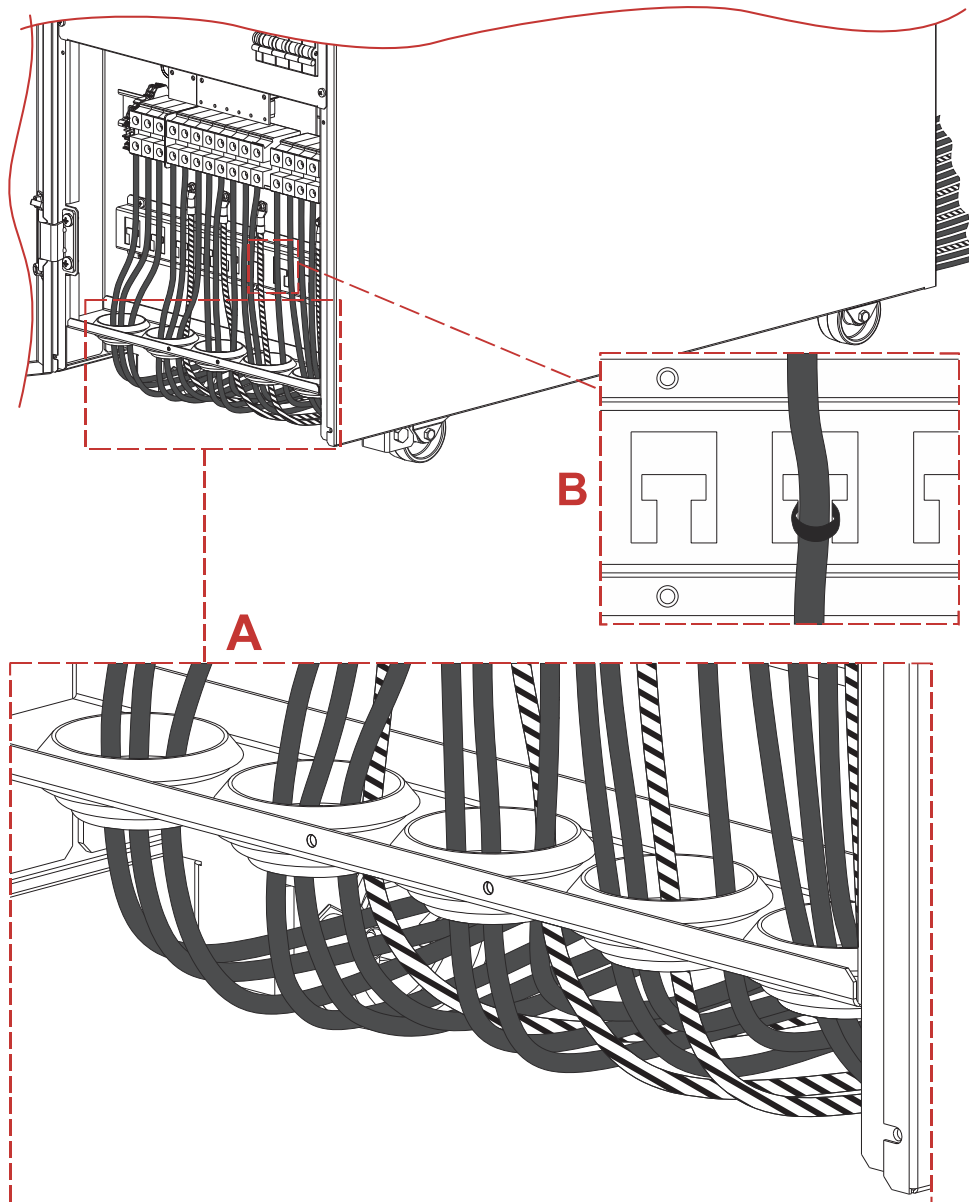


A. CABLE POSITION DETAIL

B. EXAMPLE OF THE WIRE BEING SECURED USING CABLE TIES




It should be recommended to bring each group of cables (Input, Output, Battery) through one hole separately to avoid Eddy Current.

REFIT THE FRONT TERMINAL
COVER USING THE PREVIOUSLY
REMOVED SCREWS.

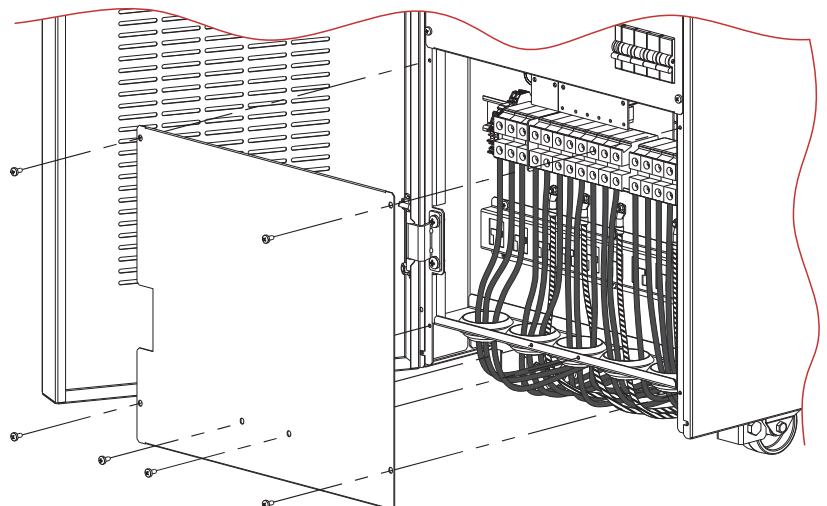


UPS DETAILS

FRONT

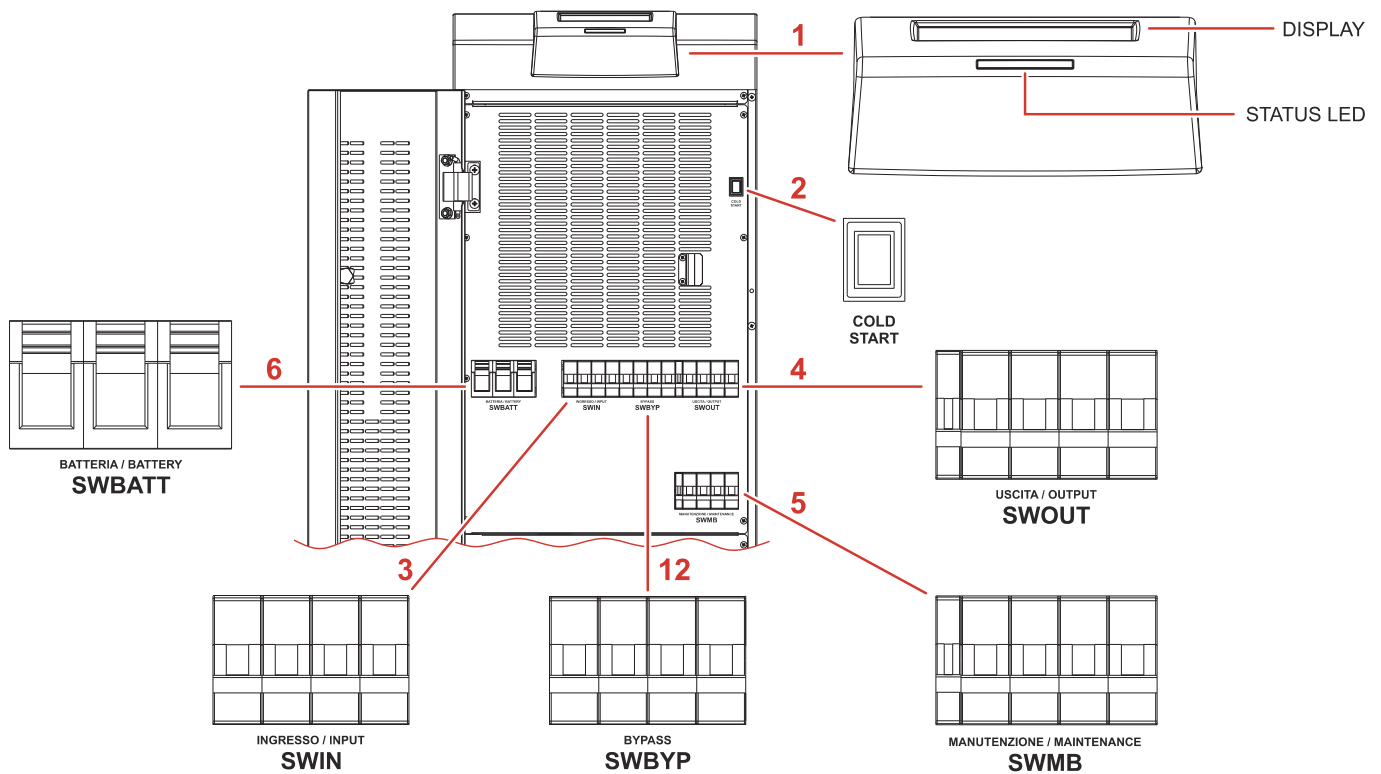

REAR

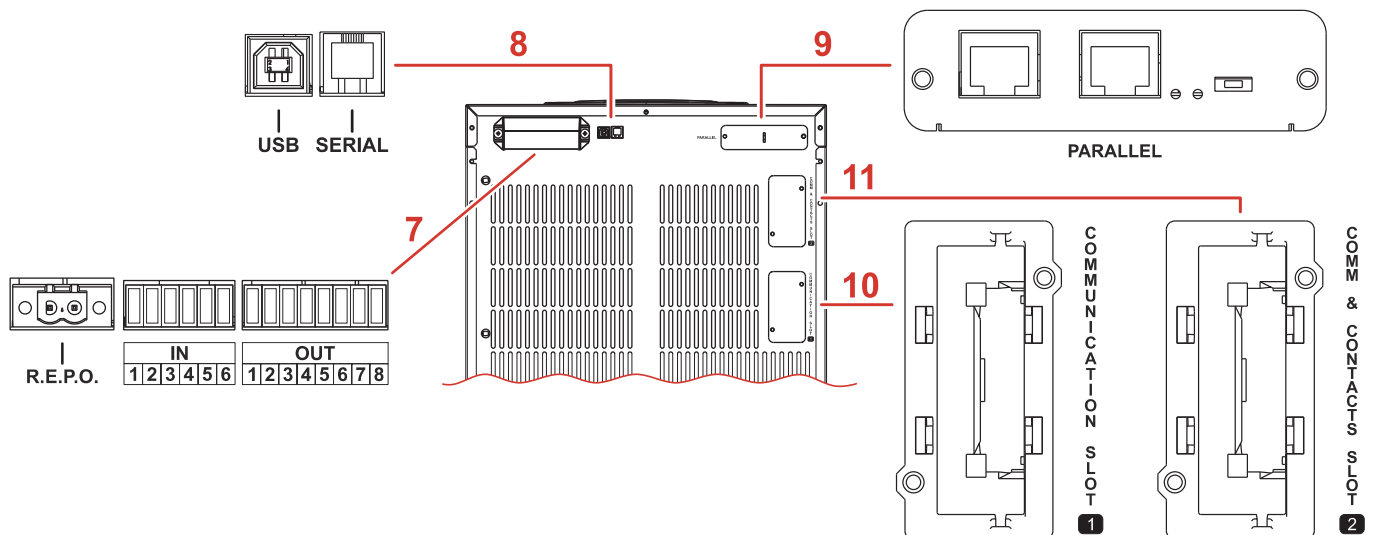

- | | |
|---|--|
| 1. Touch screen display and UPS status LED | 7. Communication ports (R.E.P.O., IN/OUT SIGNAL) |
| 2. Battery start button (COLD START) | 8. Communication ports (USB, SERIAL) |
| 3. Mains input switch (SWIN) | 9. Parallel card (optional) |
| 4. Output switch (SWOUT) | 10. Slot for optional accessory communication cards |
| 5. Manual bypass switch (SWMB) | 11. Slot for optional accessory communication and contacts cards |
| 6. Internal battery fuse holder isolator (SWBATT) | 12. Bypass input switch (SWBYP) (optional) |

POWER CONNECTION DETAILS

S3T - THREE PHASE VERSION




The first wire to be connected is the protective earth wire, which is to be inserted in the terminal marked PE. During operation the UPS must be connected to the earthing system.

Connect the input and output cables to the terminal blocks as indicated in the figure below:

TERMINAL BLOCK COLOURS				
RED	BLACK	GREY	BEIGE	BLUE
External battery positive	External battery negative	Input & Bypass Phases	Output Phases	Input, Output and external battery Neutral




THE INPUT AND BYPASS NEUTRALS MUST ALWAYS BE CONNECTED.

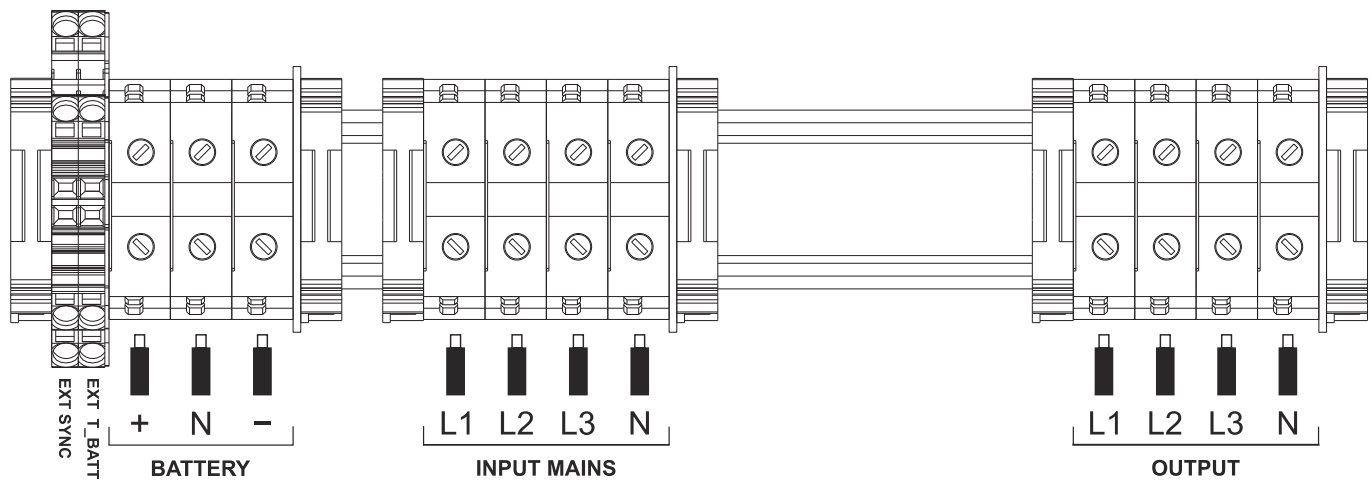

DUAL INPUT VERSION (OPTIONAL)



THE INPUT AND BYPASS LINES MUST BE REFERENCED TO THE SAME NEUTRAL POTENTIAL.

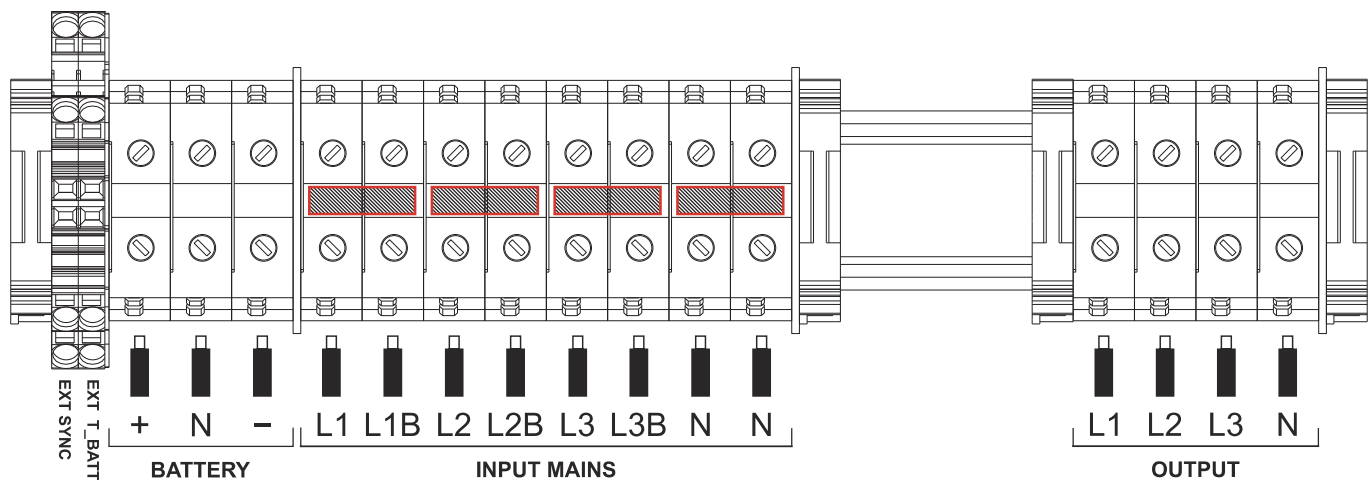

Jumpers (for more details about their installation or removal, refer to "APPENDIX")

The jumpers are installed by default to connect the bypass to input terminal blocks. Remove these jumpers if a separate bypass has to be connected.

Note: connection to the BATTERY terminal blocks is only required if an (optional) Battery Cabinet is present.

S3M - SINGLE PHASE VERSION




The first wire to be connected is the protective earth wire, which is to be inserted in the terminal marked PE. During operation the UPS must be connected to the earthing system.

Connect the input and output cables to the terminal blocks as indicated in the figure below:

TERMINAL BLOCK COLOURS				
RED	BLACK	GREY	BEIGE	BLUE
External battery positive	External battery negative	Input & Bypass Phases	Output Phases	Input, Output and external battery Neutral



THE INPUT AND BYPASS NEUTRALS MUST ALWAYS BE CONNECTED.

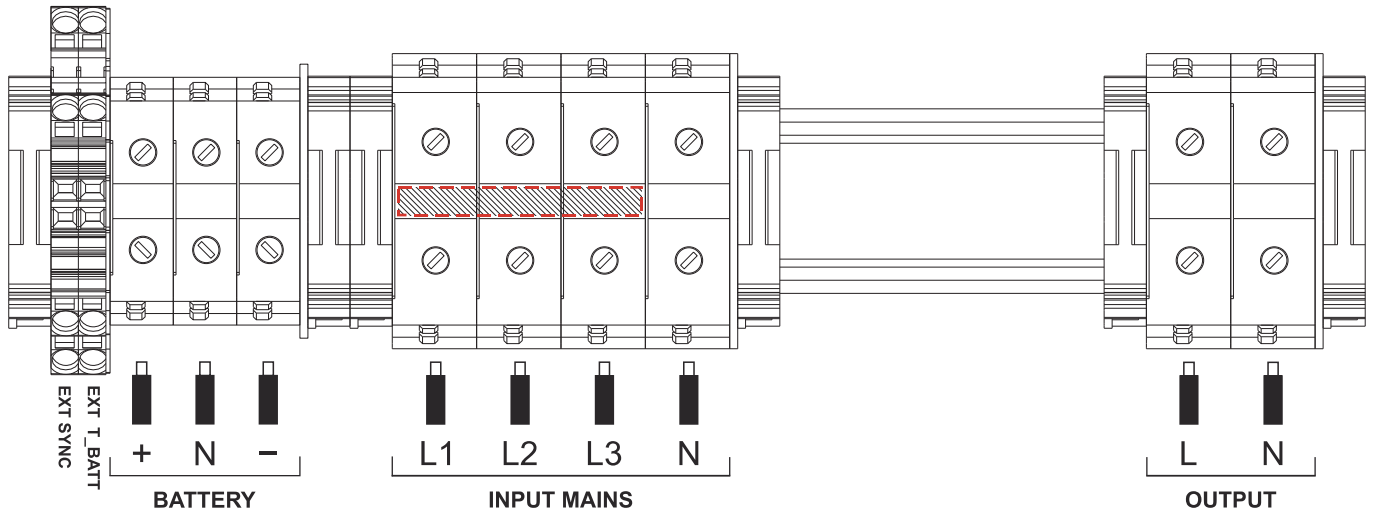


Jumpers (for more details about their installation or removal, refer to "APPENDIX")

To connect a single-phase source to the input: fit the supplied jumper to link the three input terminal blocks, as shown in the image above. The jumper is supplied within the accessories box. Then connect the phase cable to the L1 terminal block.

DUAL INPUT VERSION



THE INPUT AND BYPASS LINES MUST BE REFERENCED TO THE SAME NEUTRAL POTENTIAL.

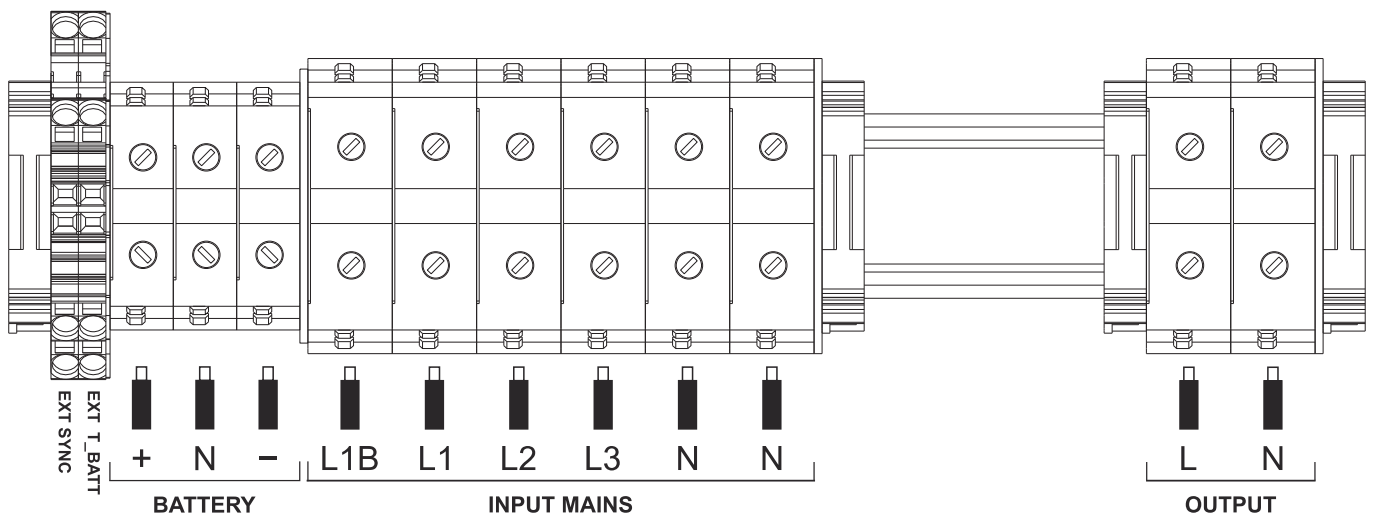


Note: connection to the BATTERY terminal blocks is only required if an (optional) Battery Cabinet is present.



Jumpers: For more information regarding all possible configurations, refer to Table 23.

XTD


POSITIONING INFORMATION

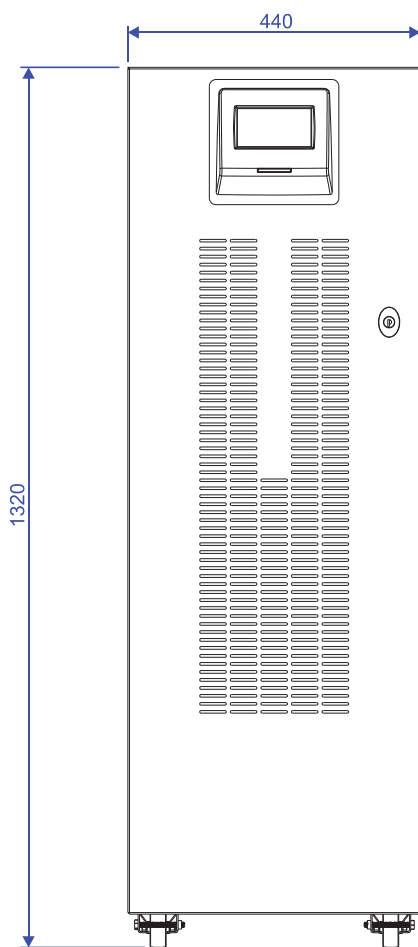


FRONT VIEW




REAR VIEW

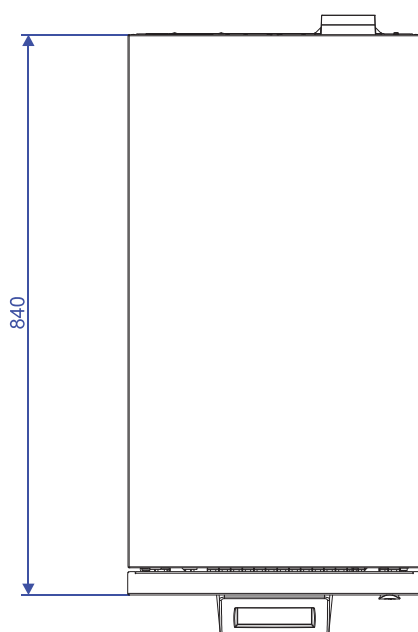

TOP VIEW

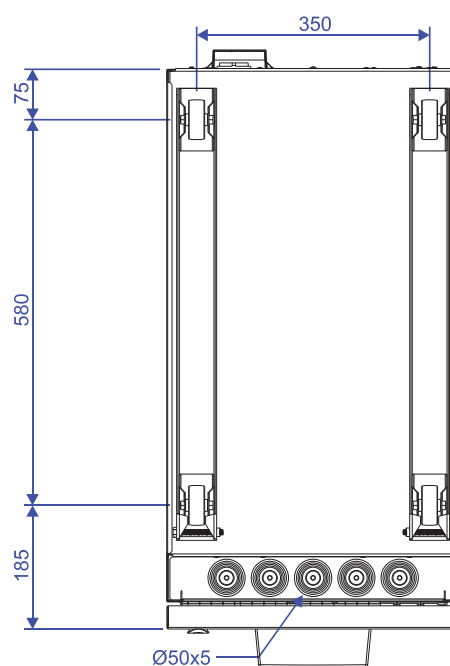


BOTTOM VIEW

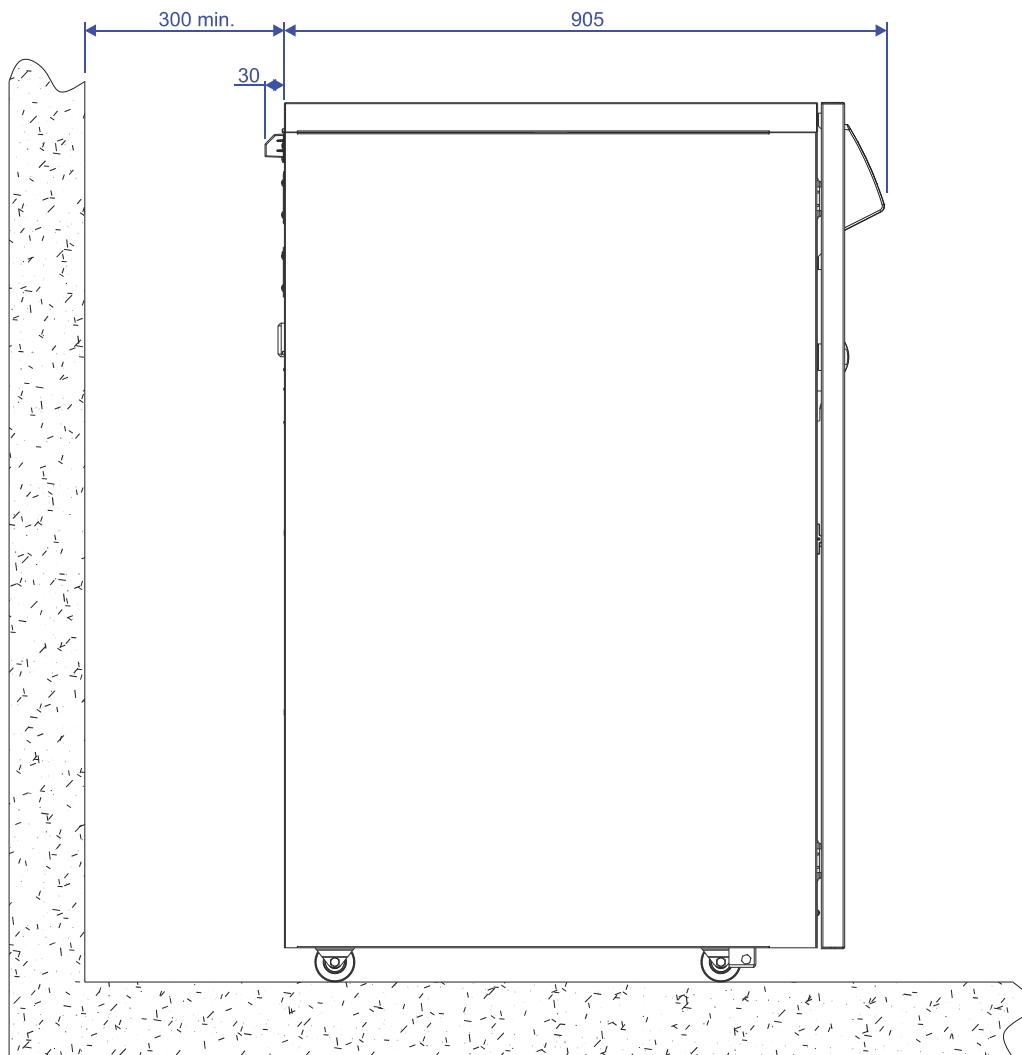



SIDE VIEW

POWER CONNECTION INSTALLATION

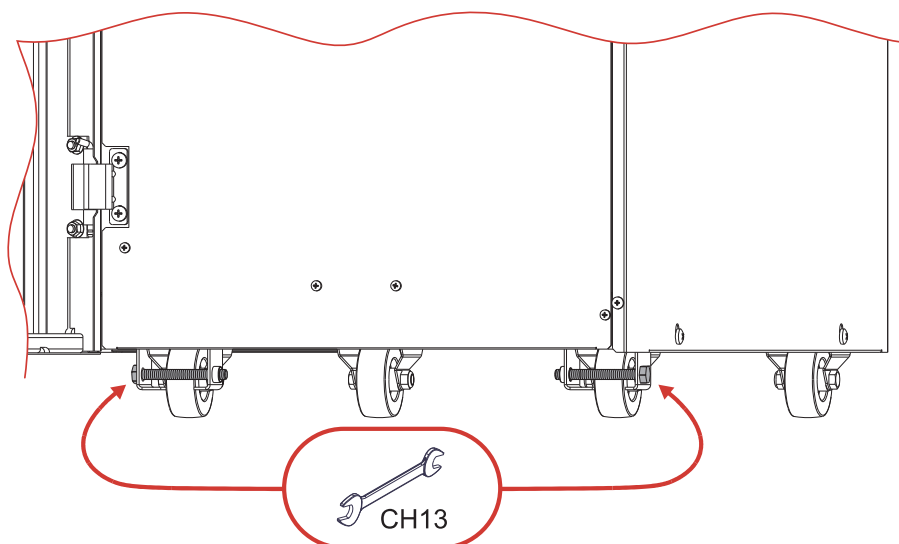


BEFORE ANY OPERATION, LOCK THE
FRONT WHEELS USING THE
SPECIFIC SCREW


REMOVE THE FRONT TERMINAL COVER

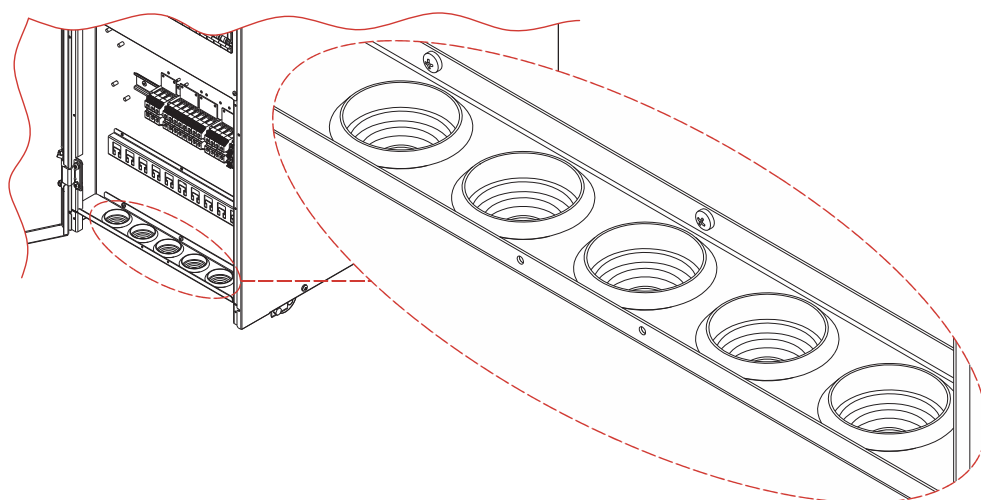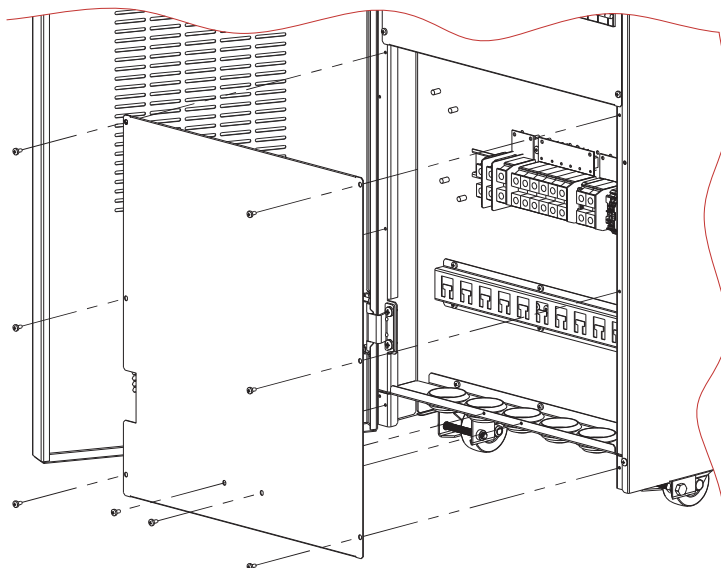

CUT A SUITABLE HOLE IN THE CABLE GLANDS PROVIDED TO MAINTAIN THE REQUIRED DEGREE OF PROTECTION

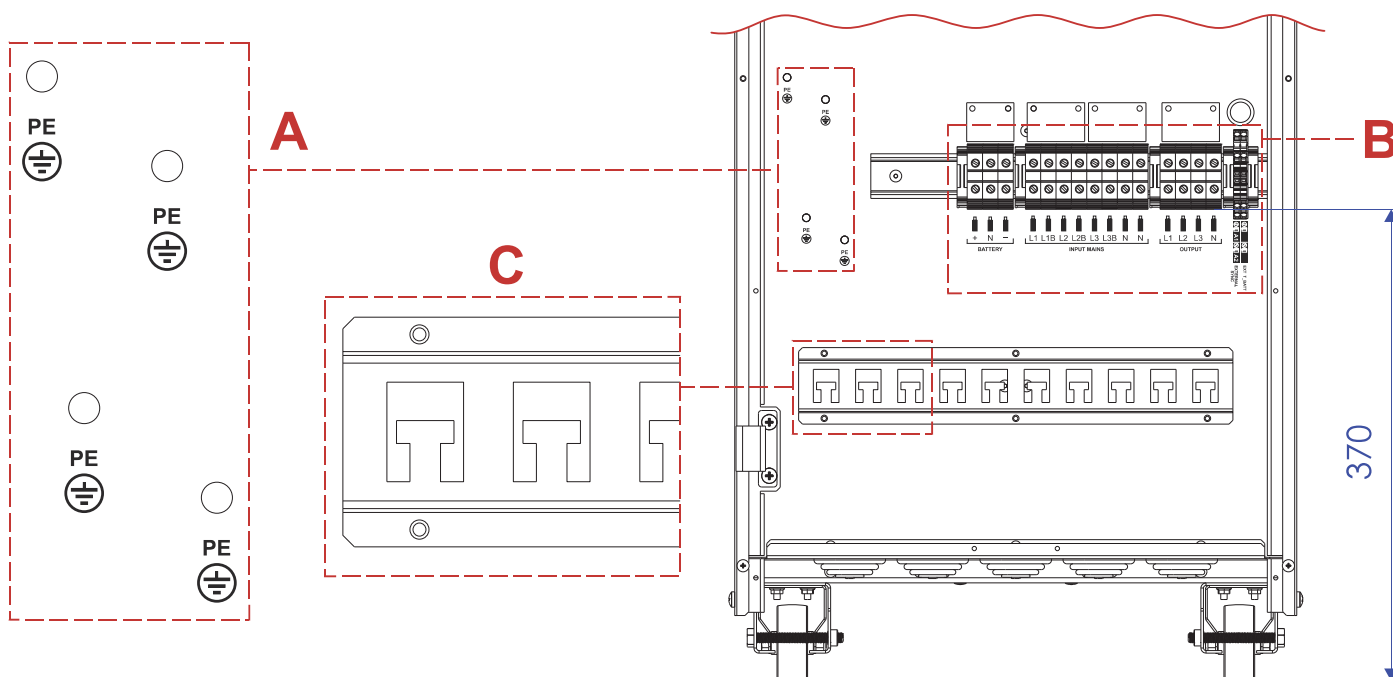

- A. PE CONNECTION
- B. TERMINAL BLOCKS (FOR MORE INFORMATION REFER TO "POWER CONNECTION DETAILS")
- C. CABLE SECURING BRACKET

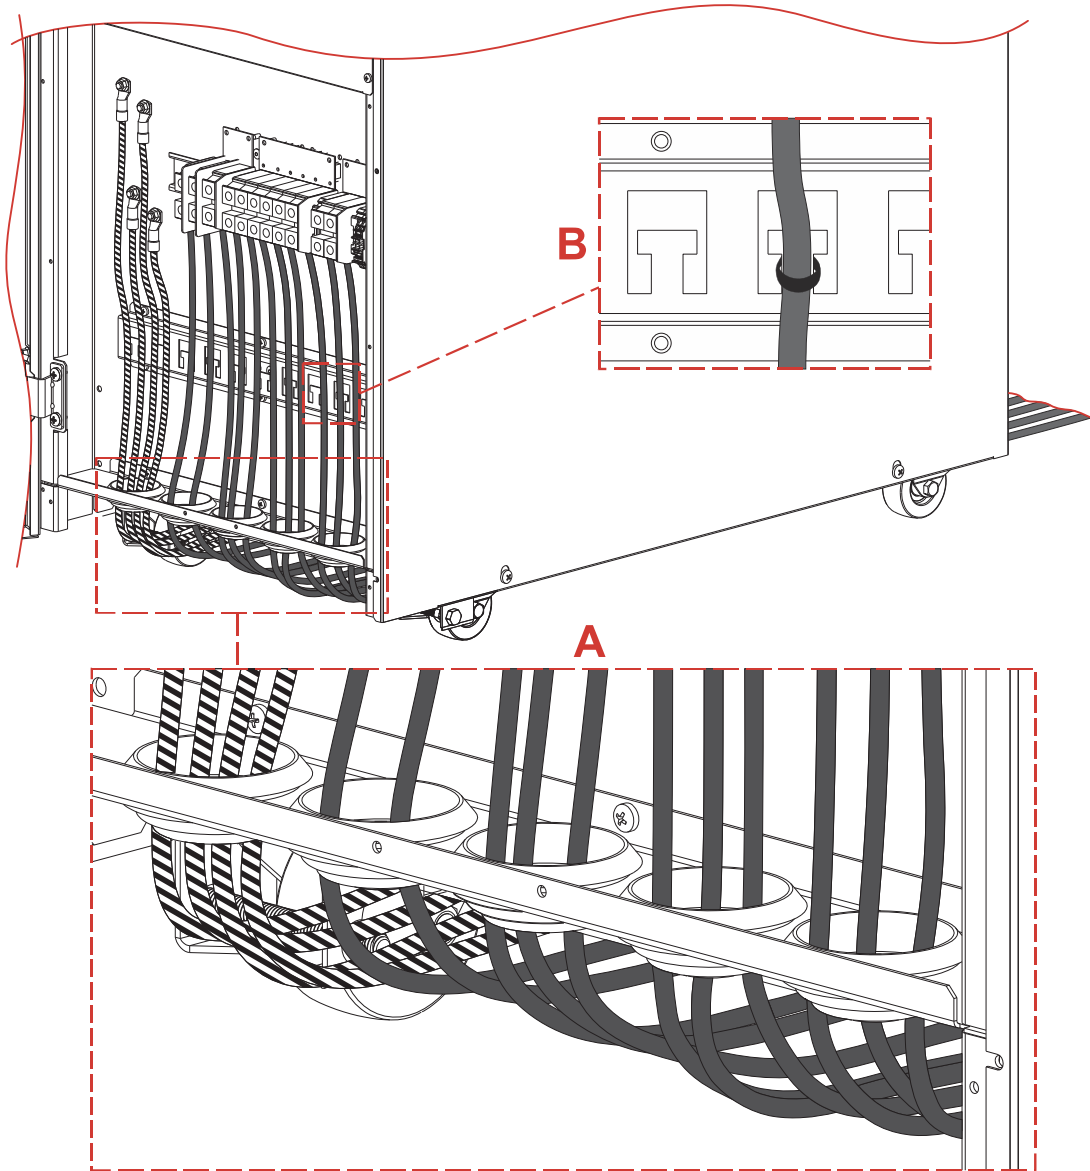


A. CABLE POSITION DETAIL

B. EXAMPLE OF THE WIRE BEING SECURED USING CABLE TIES




It should be recommended to bring each group of cables (Input, Output, Battery) through one hole separately to avoid Eddy Current.

REFIT THE FRONT TERMINAL COVER USING THE PREVIOUSLY REMOVED SCREWS.

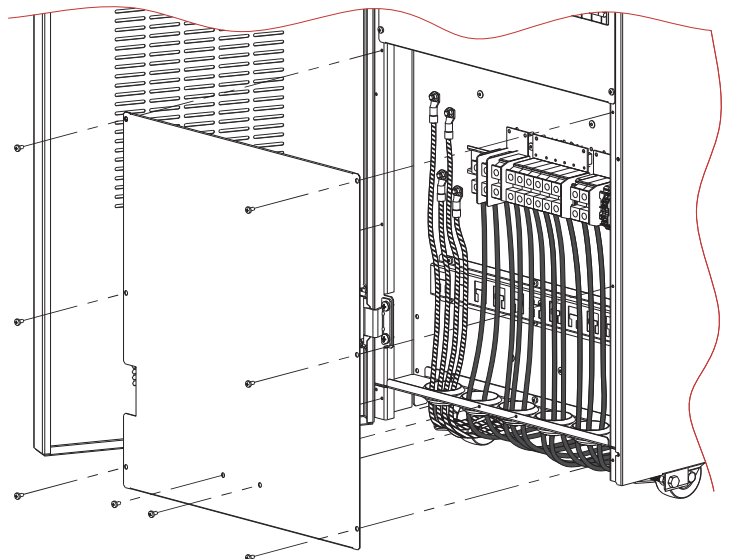


UPS DETAILS

FRONT

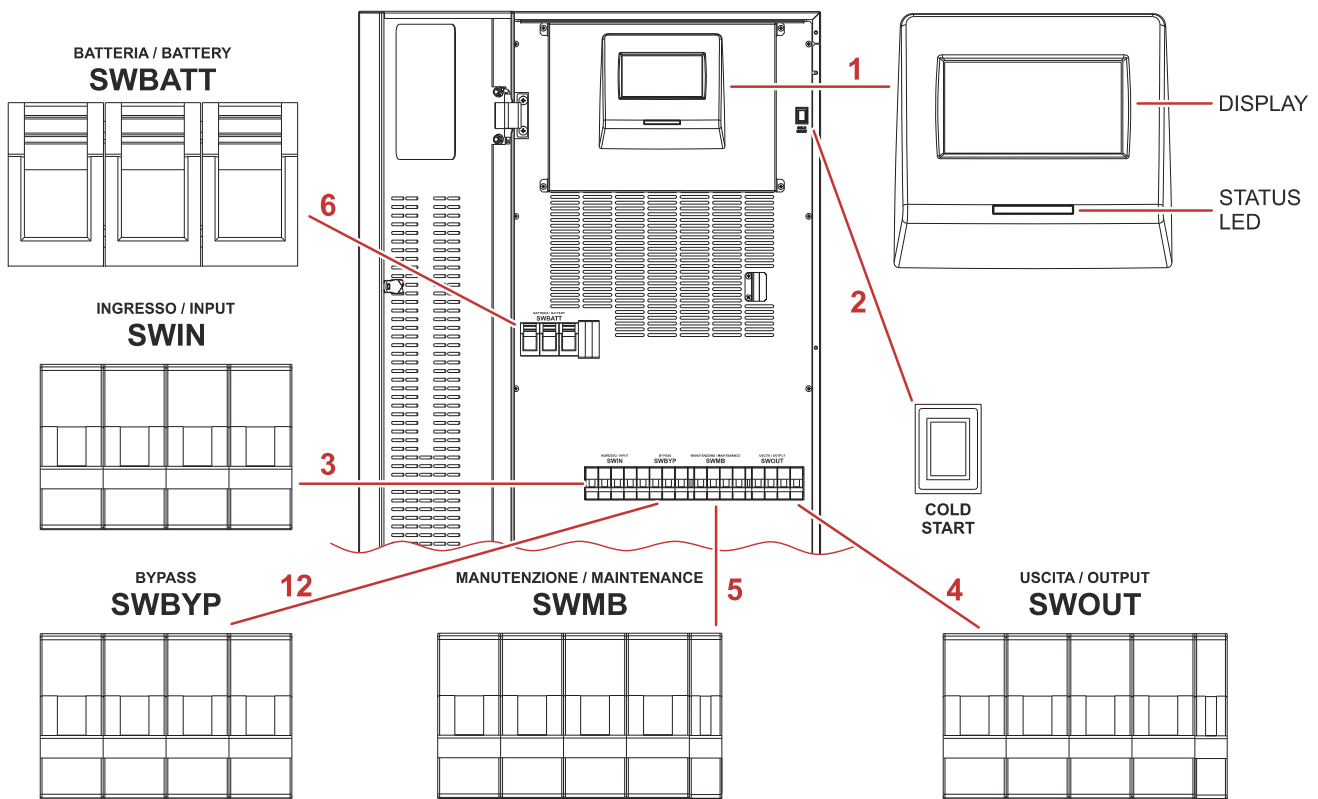

REAR

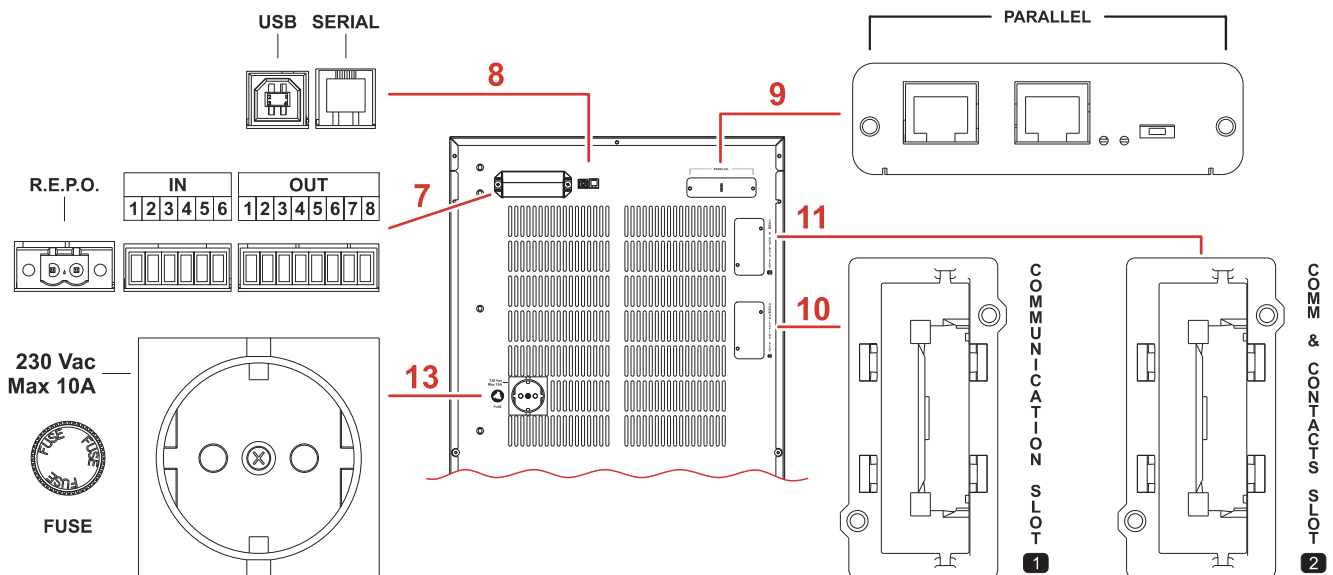

- | | |
|--|---|
| 1. Touch screen display and UPS status LED | 8. Communication ports (USB, SERIAL) |
| 2. Battery start button (COLD START) | 9. Parallel card (optional) |
| 3. Mains input switch (SWIN) | 10. Slot for optional accessory communication cards |
| 4. Output switch (SWOUT) | 11. Slot for optional accessory communication and contacts cards |
| 5. Manual bypass switch (SWMB) | 12. Bypass input switch (SWBYP) (optional) |
| 6. Internal battery fuse holder isolator (SWBATT) | 13. Schuko socket (10A max) |
| 7. Communication ports (R.E.P.O., IN/OUT SIGNAL) | |

POWER CONNECTION DETAILS



The first wire to be connected is the protective earth wire, which is to be inserted in the terminal marked PE. During operation the UPS must be connected to the earthing system.


Connect the input and output cables to the terminal blocks as indicated in the figure below:

TERMINAL BLOCK COLOURS				
RED	BLACK	GREY	BEIGE	BLUE
External battery positive	External battery negative	Input & Bypass Phases	Output Phases	Input, Output and external battery Neutral



**THE INPUT AND BYPASS NEUTRALS MUST ALWAYS BE CONNECTED.
THE INPUT AND BYPASS LINES MUST BE REFERENCED TO THE SAME NEUTRAL POTENTIAL.**


S3T - THREE PHASE VERSION

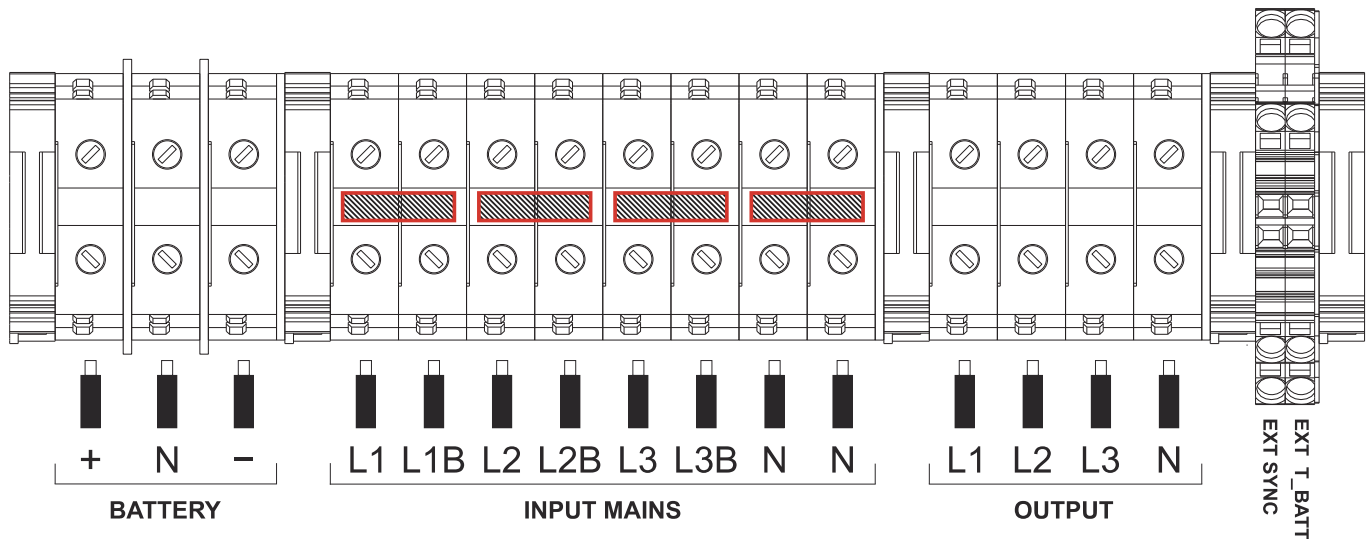

Jumpers (for more details about their installation or removal, refer to "APPENDIX")

The jumpers are installed by default to connect the bypass to input terminal blocks. Remove these jumpers if a separate bypass has to be connected.

S3M - SINGLE PHASE VERSION

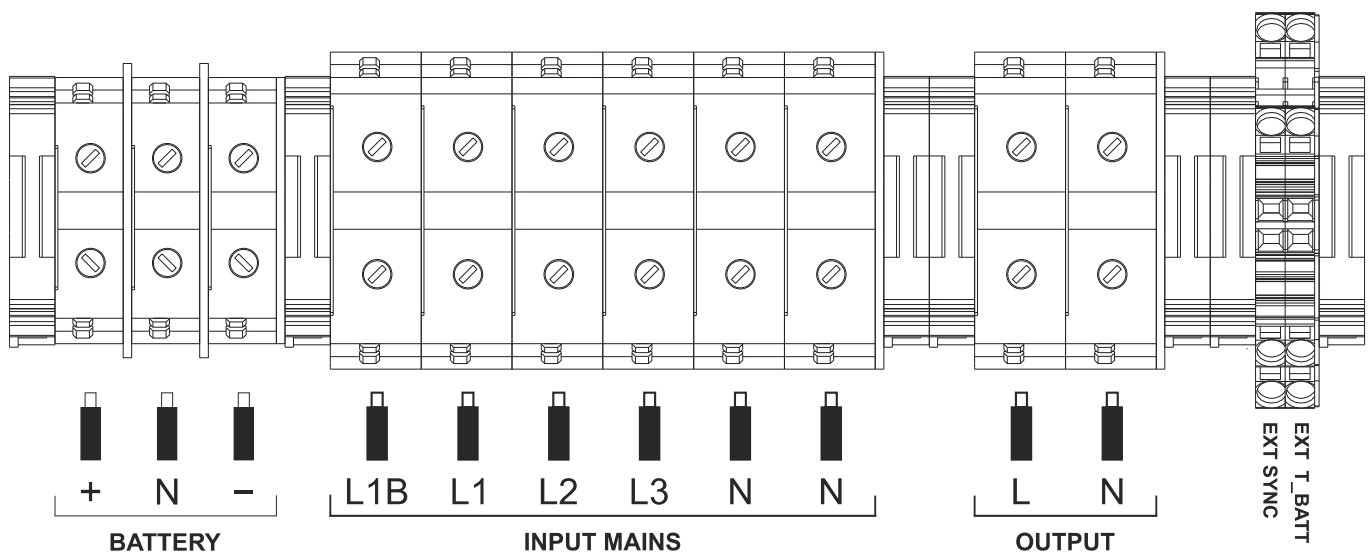

Note: connection to the BATTERY terminal blocks is only required if an (optional) Battery Cabinet is present.

CONNECTION OF S3M DUAL INPUT

Follow the table below for the correct jumper configuration of the terminal blocks, depending on the power connection required.

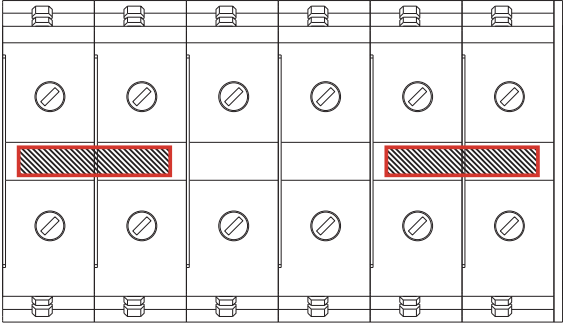

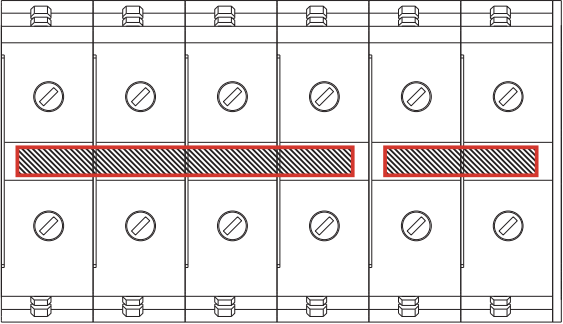

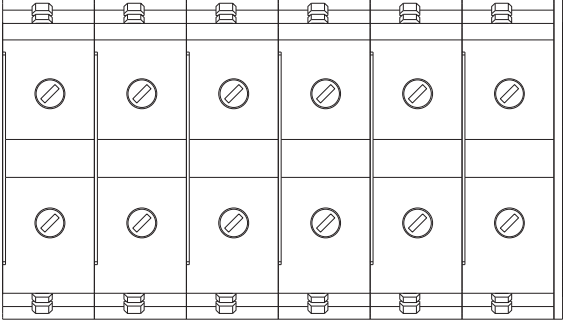

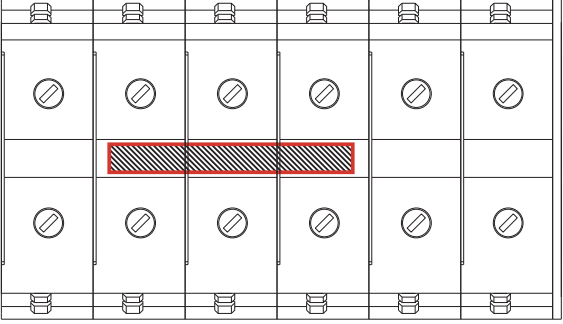

S3M default configuration (three phase input, with the bypass commoned with PH1)	S3M Single phase input, with a common bypass
 <div data-bbox="161 696 726 824">  <p>L1 L2 L3 N</p> </div> <p>INPUT MAINS</p>	 <div data-bbox="869 696 1434 824">  <p>L1 N</p> </div> <p>INPUT MAINS</p>
S3M three phase input with a separated bypass line	S3M Single phase input, with a separated bypass line
 <div data-bbox="161 1359 726 1487">  <p>L1B L1 L2 L3 N N</p> </div> <p>INPUT MAINS</p>	 <div data-bbox="869 1359 1434 1487">  <p>L1B L1 N N</p> </div> <p>INPUT MAINS</p>


Table 23



Jumpers (for more details about their installation or removal, refer to "APPENDIX")

COMMUNICATION INTERFACE

R.E.P.O.



R.E.P.O.

This isolated input is used to turn the UPS off remotely in case of an emergency.

The UPS is supplied from the factory with the "Remote Emergency Power Off" (R.E.P.O.) terminals short-circuited (refer to "UPS DETAILS" ref.7). If it is to be installed, remove the short-circuit and connect to the normally closed contact of the stop device using a double insulated cable.

In case of emergency, by activating the stop device, the R.E.P.O. control is opened, and the UPS will shut-down (refer to USER MANUAL), and the load will be powered off completely.

The R.E.P.O. circuit is self-powered using a SELV type circuit. No external power supply voltage is therefore required. When it is closed (normal condition), a maximum current of 15mA is present.


NOTE: If more than one UPS is to be connected within the same R.E.P.O system. Each UPS must be provided with its own dedicated separate set of contacts. Do not connect the systems in parallel or series.

PROGRAMMABLE IN – OUT SIGNALS

The IN-OUT signals (refer to "UPS DETAILS" ref. 7) have a standard factory configuration. The only input signal enabled is "IN 5"; the other signals must be enabled from the display panel.

For further information refer to the "User Manual".


Moreover all the signals can be programmed using the service configuration software reserved to service personnel only.

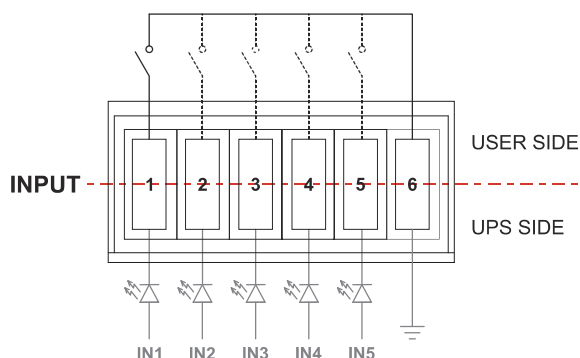

FACTORY DEFAULT SETTING

INPUT	FUNCTION
IN 1 #	Position of the External SWMB
IN 2 #	Position of the External SWOUT
IN 3 #	CB OFF
IN 4 #	Bypass ON
IN 5	System ON

These inputs must be enabled from the display panel

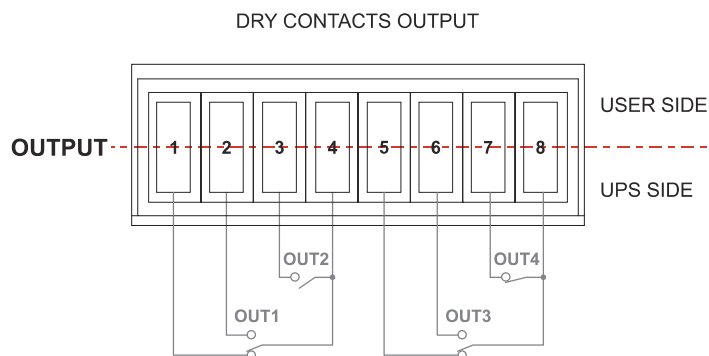


FACTORY DEFAULT SETTING:

OUTPUT	FUNCTION
OUT 1	Load on Bypass
OUT 2	Battery working
OUT 3	Battery low
OUT 4	Fault or Lock (F+L)


The output dry contacts are rated to:
1A @ 24Vdc or 1A @ 30Vac

NOTE: In case of an external maintenance bypass or Battery Cabinet installation, the relative switch auxiliary contacts must be connected to these inputs and programmed.

USB/SERIAL RS232



USB




SERIAL RS232


Use these ports to connect the UPS to a server or PC for remote monitoring, service configuration or firmware update.

These two ports cannot be used simultaneously. The USB port is to be used as an alternative to the RS232 serial port. USB port function is only guaranteed with a cable length of no more than 1.5m. Where a longer cable is required it is recommended that the RS232 serial interface is used.

COMMUNICATION SLOTS

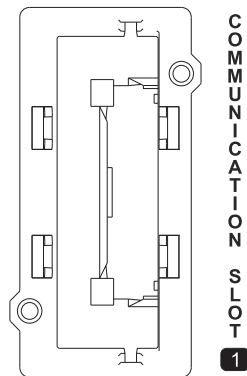

SLOT 1

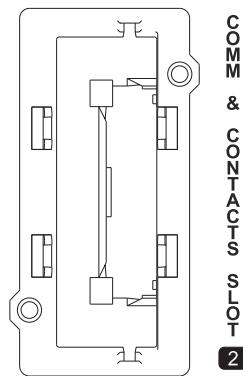

SLOT 2

The UPS is provided with two communication slots (refer to "UPS DETAILS" ref.10) which can be used to host optional communications cards. The slots are not interchangeable.

SLOT 1 - Communication Slot

Slot to accommodate the communication cards (no contact or relay cards).

SLOT 2 – Communication and Contacts Slot

Slot to accommodate additional communication cards (default configuration), or contact/relay expansion cards.

Please refer to the optional card kit user manual for further information.


APPENDIX

JUMPERS INSTALLATION/REMOVAL


Depending on the type of terminal blocks, to install or remove any jumpers refer to the following images.

TYPE 1

Installation

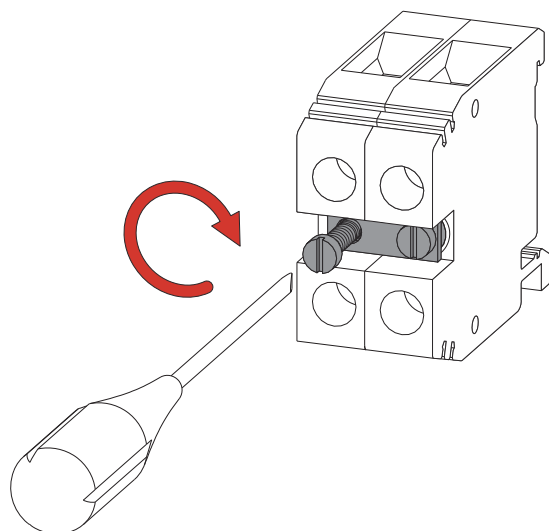


Removal

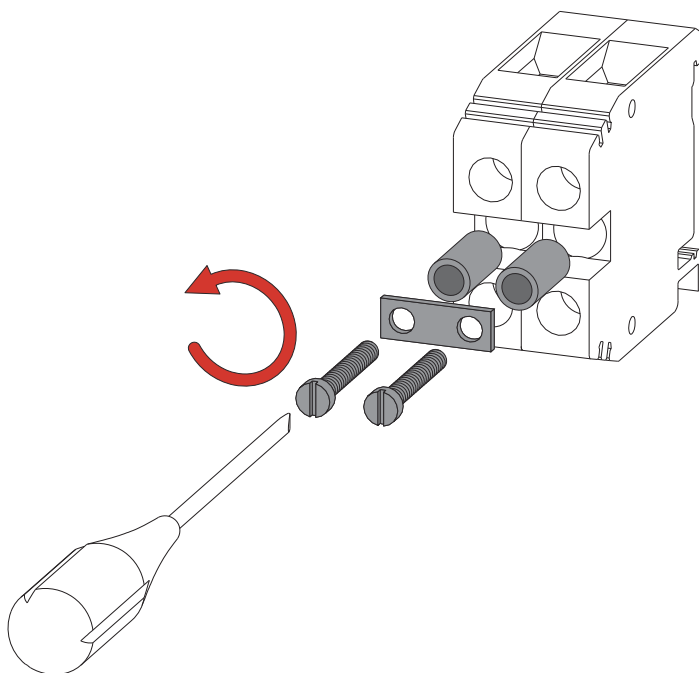


TYPE 2

Installation

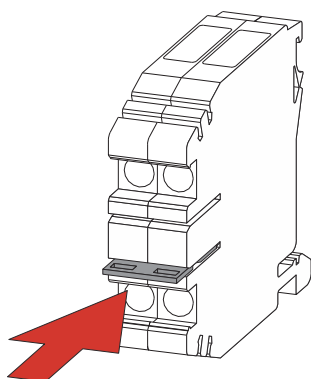

Removal

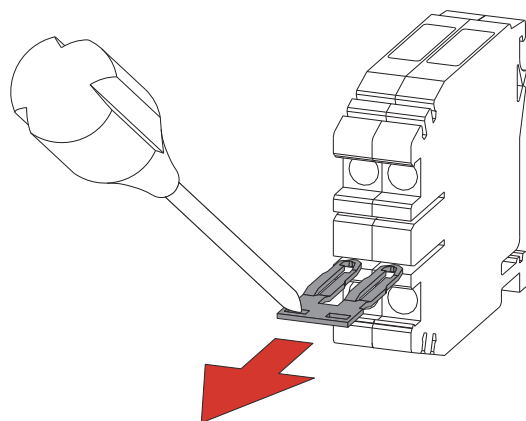


CHECKING THE PACKAGING CONTENTS


Inside the packaging, in addition to the UPS, there is the accessory box.

Check that the following items are present inside the accessory box:


USB pendrive
(containing the various manuals in different languages)

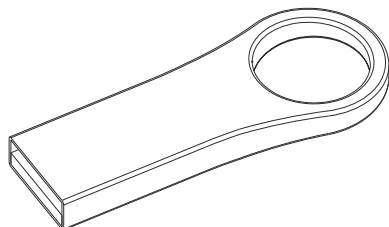

Download card +
risk of voltage backfeed labels (x3)

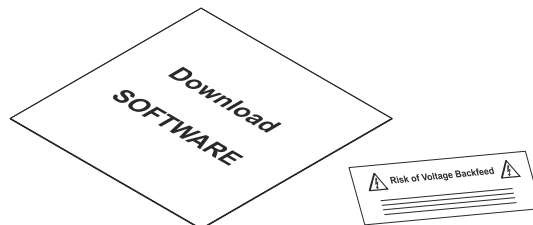


Installation manual

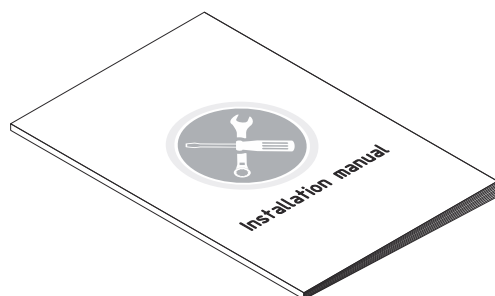


Safety manual + RAEE/WEEE manual




USB communication cable

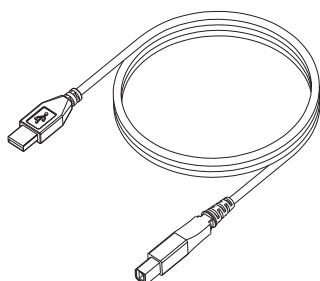


Battery fuses (x3)




Grommet caps (x5)



Plastic supports for cable ties (CPT: x5 – ACT, XTD: x12)




Jumpers (only for single-phase version): number and type vary according to the UPS model / version

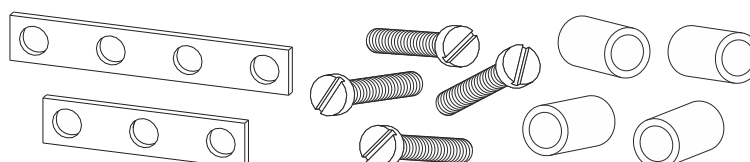


FIXING THE SIGNAL CABLE


It is possible to fix the signal cable to the dedicated accessory boards using the plastic supports inside the accessory box. For correct positioning and installation refer to the following images.

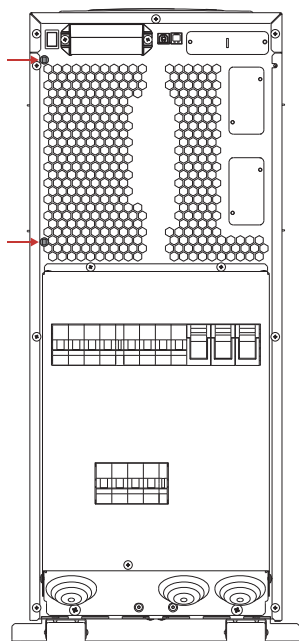


CPT

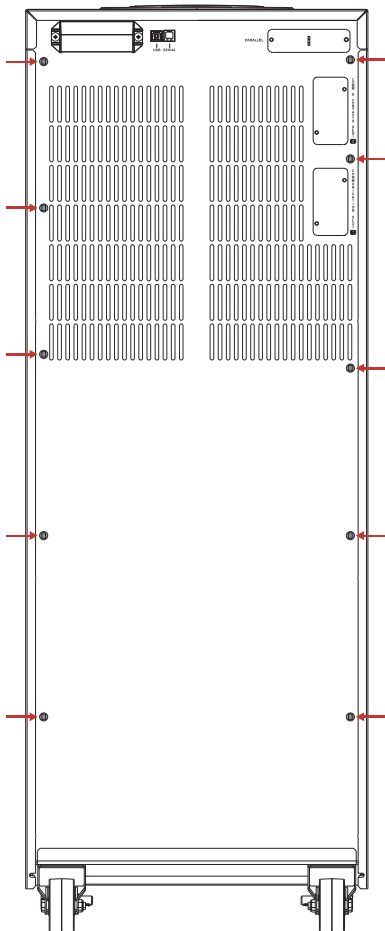


ACT

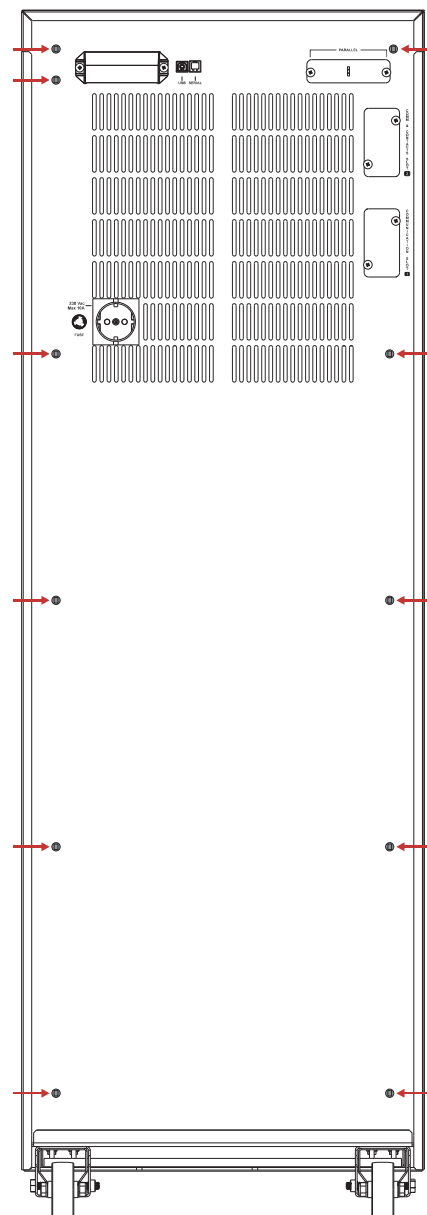

XTD

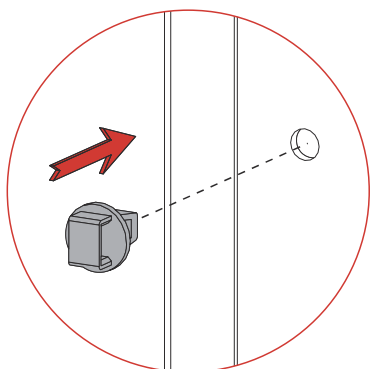


Insert the plastic supports in the provided holes

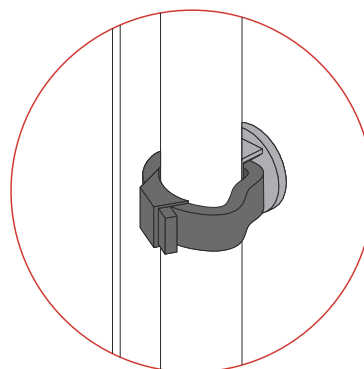


Secure the cable to the plastic supports with a cable tie

REMOVING DOOR

ACT

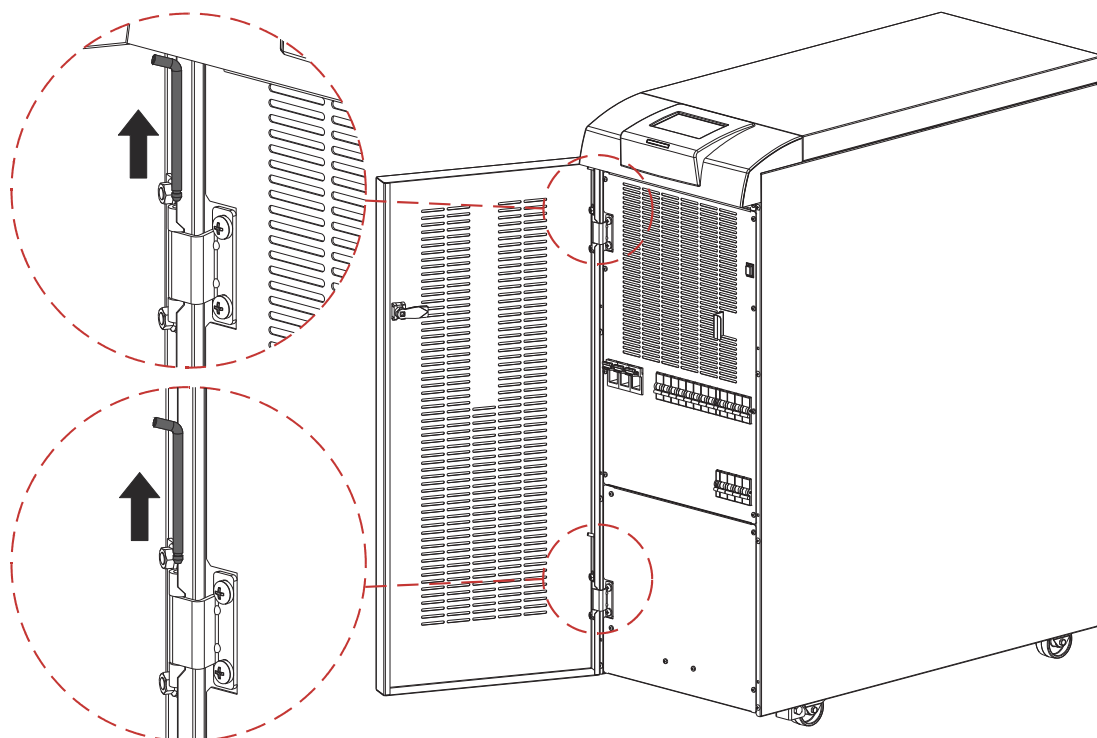


XTD

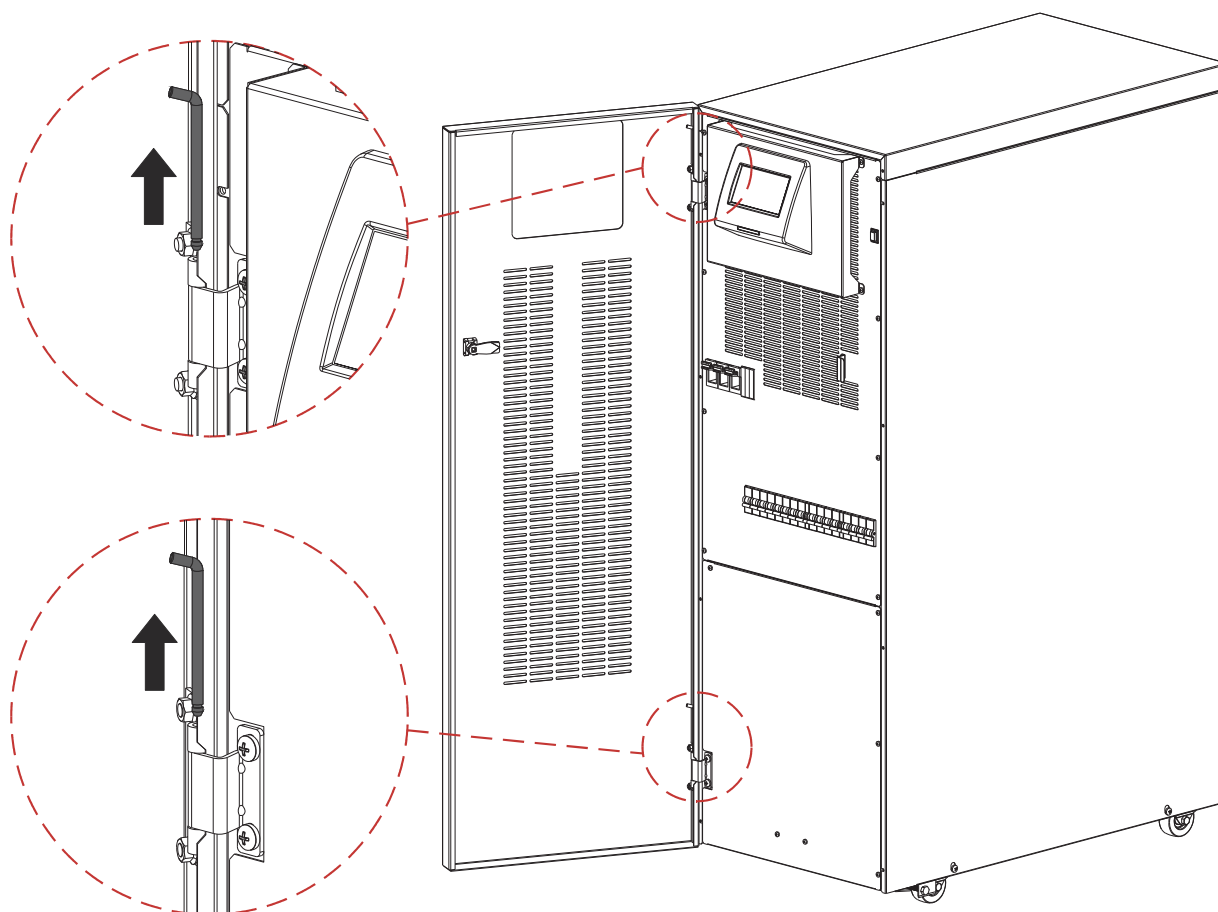

ANCHORING THE UPS TO THE FLOOR

In earthquake zones or on mobile systems, it is possible to reuse the brackets for pallet fastening (or slides) to anchor the UPS to the floor (see figure below). These brackets are not necessary in normal conditions.

CPT

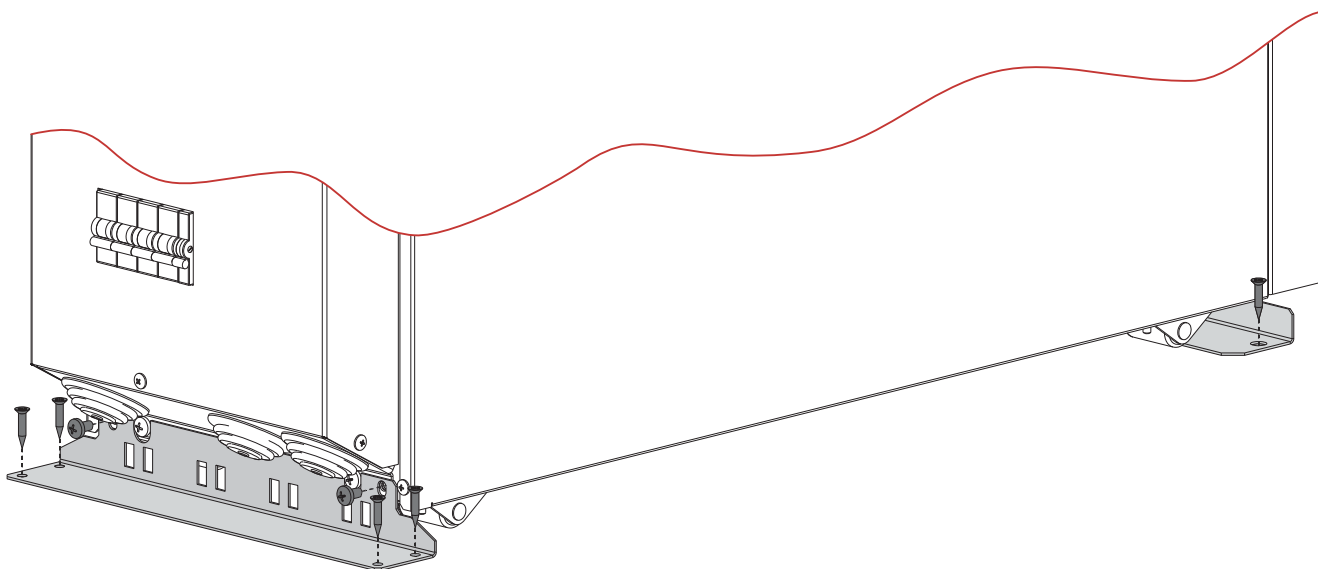

ACT - XTD

